



Process Controller with Setpoint Programmer

1/16 DIN - 48 x 48

Platinum™
SERIES

M5000 line

User Manual • M.I.U.M5000-3/01.02 • Cod. J30-478-1AM5 SEA




ATHENA CONTROLS, INC.
5145 Campus Drive
Plymouth Meeting
PA 19462 U.S.A.
Tel: (610) 828-2490
Fax: (610) 828-7084
AthenaControls.com



**Process Controller
with Setpoint
Programmer**
1/16 DIN - 48 x 48

M5000 line

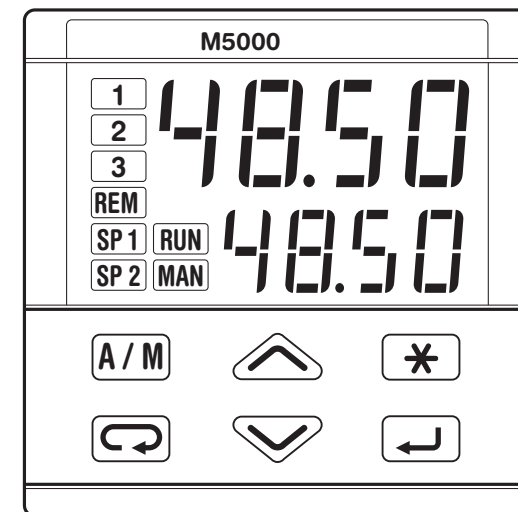



NOTES

ON ELECTRIC SAFETY AND ELECTROMAGNETIC COMPATIBILITY

Please, read carefully these instructions before proceeding with the installation of the controller.

Class II instrument, rear panel mounting.

This controller has been designed with compliance to:

Regulations on electrical apparatus (appliance, systems and installations) according to the European Community directive 73/23 CEE amended by the European Community directive 93/68 CEE and the Regulations on the essential protection requirements in electrical apparatus EN 61010-1 (IEC 1010 - 1) : 90 +A1:92 + A2:95.

Regulations on Electromagnetic Compatibility according to the European Community directive n089/336/CEE, amended by the European Community directive n° 92/31/CEE and the following regulations:

Regulations on RF emissions

EN50081 - 1 residential environments

EN50081 - 2 for industrial environments

Regulation on RF immunity

EN500082-2 for industrial equipment and system

It is important to understand that it's responsibility of the installer to ensure the compliance of the regulations on safety requirements and EMC.

The device has no user serviceable parts and requires special equipment and specialised engineers. Therefore, a repair can be hardly carried on directly by the user. For this purpose, the manufacturer provides technical assistance and the repair service for its Customers.

Please, contact your nearest Agent for further information.

All the information and warnings about safety and electromagnetic compatibility are marked with the   sign, at the side of the note.

TABLE OF CONTENTS

1	INTRODUCTION	PAGE	4
	1.1 PRODUCT CODING	PAGE	5
2	INSTALLATION	PAGE	6
	2.1 DESCRIPTION	PAGE	6
	2.2 OPERATING CONDITIONS	PAGE	7
	2.3 INSTALLATION	PAGE	7
3	ELECTRICAL CONNECTIONS	PAGE	8
	3.1 TERMINATION UNIT	PAGE	8
	3.2 CABLING LAYOUT	PAGE	8
	3.3 ELECTRICAL CONNECTIONS	PAGE	9
4	OPERATIONS	PAGE	15
	4.1 FRONT PANEL	PAGE	15
	4.2 CONFIGURATION	PAGE	16
	4.3 PARAMETER SETTING	PAGE	20
	4.4 ACCESS LEVELS	PAGE	27
5	DISPLAYS	PAGE	29
6	COMMANDS	PAGE	30
	6.1 COMMANDS FROM KEYBOARD	PAGE	31
	6.2 COMMANDS FROM DIGITAL INPUTS	PAGE	33
	6.3 COMMANDS FROM SERIAL COMMUNICATION (PLEASE, REFER THE ADDENDUM ON THE SERIAL COMMUNICATION)		
7	SETPOINT PROGRAMMER (OPTIONAL)	PAGE	34
	7.1 PROGRAM ORGANISATION	PAGE	34
	7.2 OPERATING CONDITIONS	PAGE	36
	7.3 PROGRAM INPUT AND EDITING	PAGE	37
	7.4 RUN/STOP OF A PROGRAM	PAGE	38
8	TECHNICAL SPECIFICATIONS	PAGE	39

1 INTRODUCTION

Congratulations for having chosen these universal controllers. They are the best result of our experience in designing and manufacturing of smart, powerful and high reliable controllers.

POWERFUL FEATURES AND A WIDE RANGE OF FUNCTIONALITIES

The process controllers of the M5000 series have been designed for the industrial environment, are provided with a complete set of functions, as a true universal instrument.

They can be used as Controllers-Programmers with 1 Setpoint profile of 16 segments.

Resources

Main universal input


6 TC Pt100 ΔT mA V Custom PV

Auxiliary input (option)

POT. REM mA REM V AUX

Two digital inputs

DI1 DI2



M5000

Memory Chip
Data Copy/Data Store (option)

OP1

OP2

OP3

OP4 (option)

Setpoint

LOC 2 MEM REM 1x16s

Digital inputs (DI1, DI2) functions




2 MEM REM RUN HOLD PV SP SLOPE

Modbus RS485
Parameterisation Supervision (option)

Tuning

One shot Auto tuning Adaptive


Operating mode

	Control	Alarms			Retransmission
					
	PV/SP				
1	Single output	OP1		OP2 OP3	OP4
2	Single output	OP4		OP1 OP2 OP3	
3	Heat / cool	OP1 OP2		OP3	OP4
4	Heat / cool	OP1 OP4		OP2 OP3	
5	Heat / cool	OP4 OP2	OP1	OP3	
6	Valve	OP1 OP2		OP3	OP4

1.1 PRODUCT CODING

The complete code is displayed on the instrument label.

The information about product coding are accessible from the front panel by mean of a particular procedure described at section 5.1 pag 29

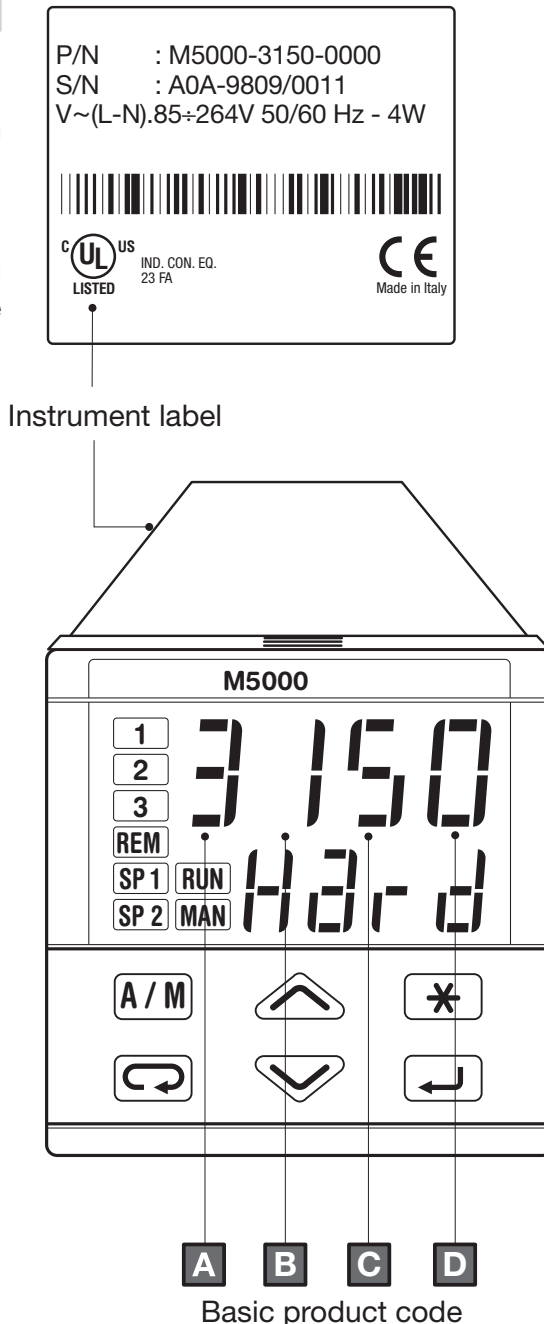

Line Model Basic Accessories
 Model: **M5000** **A** **B** **C** **D** - **E** **F** **G** **H**

Power supply		A
100 - 264Vac 48/63 Hz		3
18-28Vac 48/63 Hz and 20-30Vdc		5

OP1 [1]	OP2 [1]	OP3 [1]	B
Relay	Relay	Relay (alarm only)	1
Relay	Triac	Relay (alarm only)	2
Triac	Relay	Relay (alarm only)	4
Triac	Triac	Relay (alarm only)	5

Option 1 [2]	Option 2 [2]	C	D
None	None	0	0
	Potentiometer Input (PI)	0	1
	Remote Setpoint Input (RSP) [2]	0	2
Digital Input #2 (DI2)	Current Transformer Input (CTI)	0	3
	Logic or Analog Output 4 [3]	0	4
None	Logic or Analog Output 4 + RSP [2] [3]	0	5
	None	5	0
RS485 Modbus/Jbus	Potentiometer Input (PI)	5	1
	Remote Setpoint Input (RSP) [2]	5	2
RS485 Modbus/Jbus + DI2	Current Transformer Input (CTI) [2]	5	3
	Logic or Analog Output 4 [3]	5	4


Option 3	User manual	E	F
None	Standard English/Spanish manual	0	3
Setpoint Program 1/16 [4]	Standard English/Spanish manual	1	3

Front Bezel colour	G	H
Dark Grey (standard)	0	0
Beige	1	0

- Notes**
- [1] Relay SPST N.O. 2A/250V; Triac 1A/250V
 - [2] Not available with 'EF' option '13' of Setpoint Program 1/16
 - [3] Analog Output 4 is field configurable for control or retransmission output as 0-20mA or 4-20mA
 This output can also be field configured as a logic output at 22Vdc 20mA via software
 The addition of Output 4 does not affect any of the other three outputs
 - [4] One setpoint program with up to 16 segments, not available with 'CD' options of '02', '05', & '52'

2 INSTALLATION


Installation must only be carried out by qualified personnel.

Before proceeding with the installation of this controller, follow the instructions illustrated in this manual and, particularly the installation precautions marked with the  symbol, related to the European Community directive on electrical protection and electromagnetic compatibility.




To prevent hands or metal touching parts that may be electrically live, the controllers must be installed in an enclosure and/or in a cubicle.


2.1 INSTALLATION DESCRIPTION

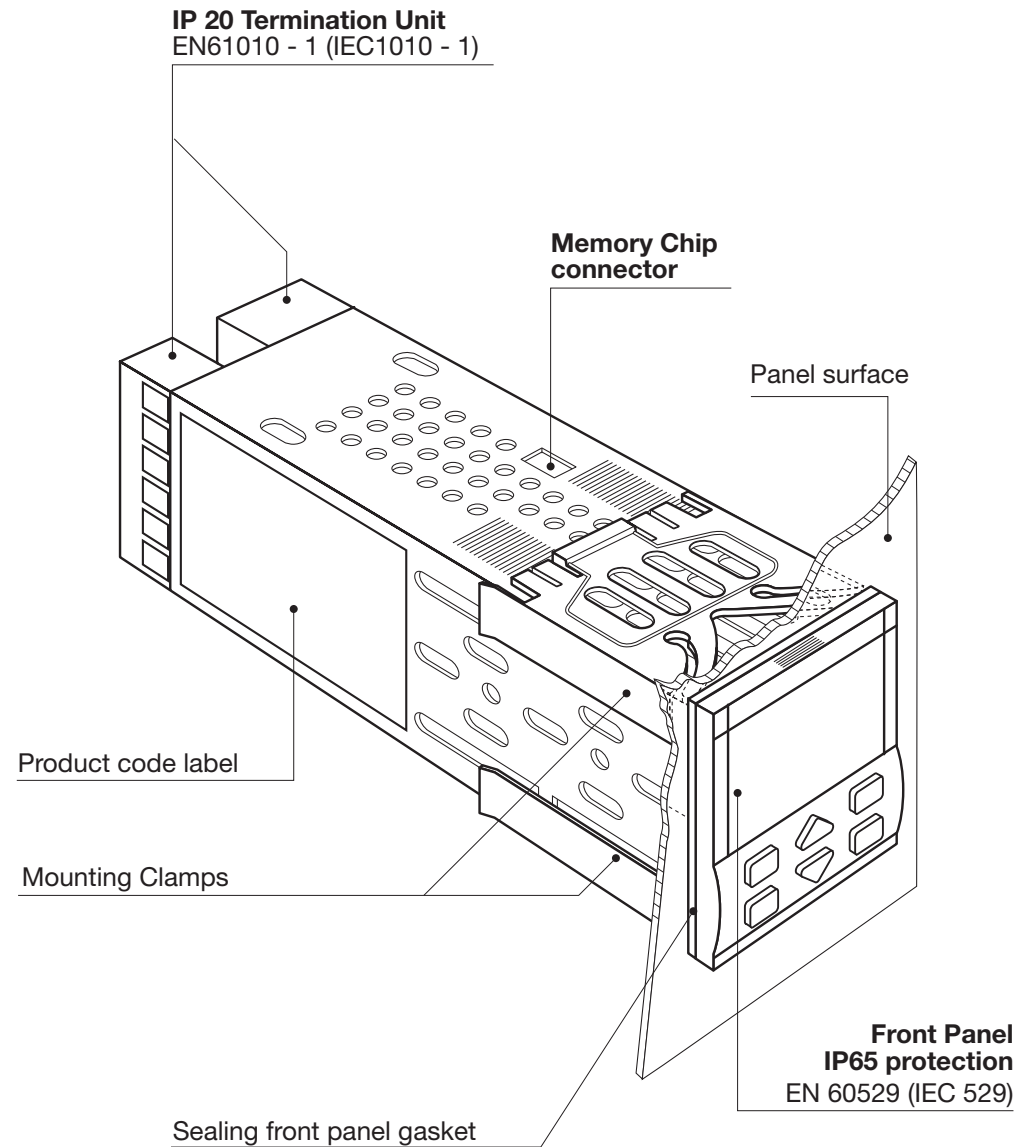

2.1.1 DIMENSIONAL DETAILS

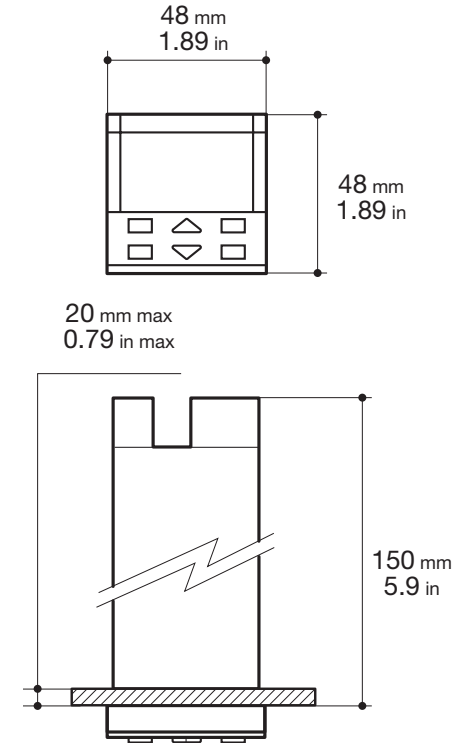

2.1.2 PANEL CUT-OUT

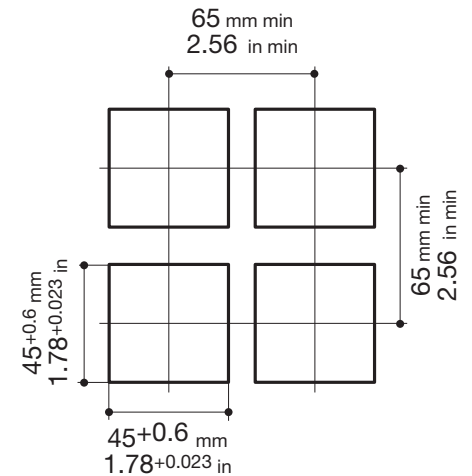

2.2 ENVIRONMENTAL RATINGS



Operating Conditions



Altitude up to 2000 m



Temperature 0...50°C

%Rh

Relative Humidity 5...95 %Rh non-condensing

Special Conditions

Suggestions



Altitude > 2000 m

Use 24V~ supply version



Temperature >50°C

Use forced air ventilation

%Rh

Humidity > 95 %Rh

Warm up



Conducting atmosphere

Use filters

Forbidden Conditions



Corrosive atmosphere



Explosive atmosphere


UL note

For use on a Flat Surface of a Type 2 and Type 3 "raintight" Enclosure

2.3 PANEL MOUNTING


2.3.1 INSERT THE INSTRUMENT

- 1 Prepare panel cut-out
- 2 Check front panel gasket position
- 3 Insert the instrument through the cut-out

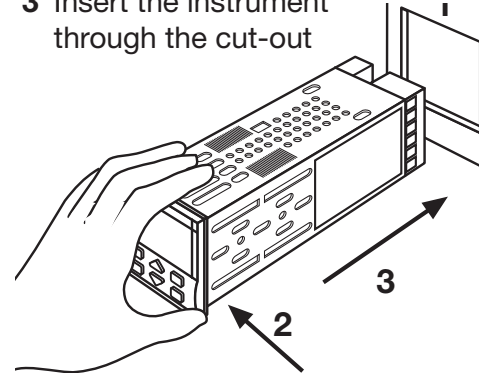


2.3.2 INSTALLATION SECURING

- 1 Fit the mounting clamps
- 2 Push the mounting clamps towards the panel surface to secure the instrument

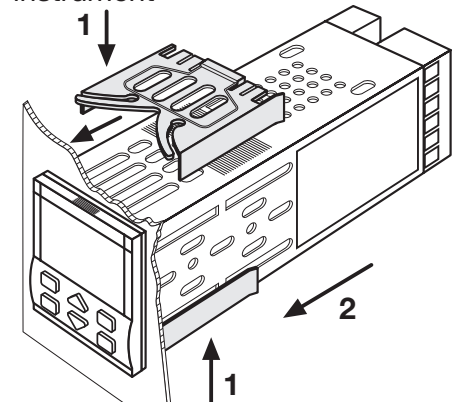

2.3.3 CLAMPS REMOVING


- 1 Insert the screwdriver in the clips of the clamps
- 2 Rotate the screwdriver

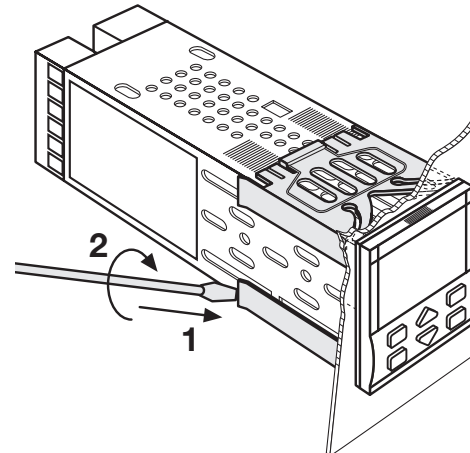

2.3.4 INSTRUMENT UNPLUGGING



- 1 Push and
 - 2 Pull to remove the instrument
- Electrostatic discharges can damage the instrument
Before removing the instrument the operator must discharge himself to ground

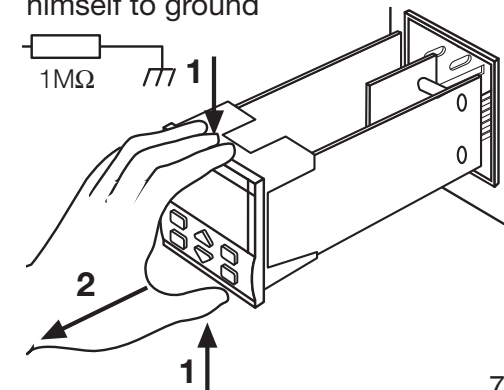

3 ELECTRICAL CONNECTIONS

PRECAUTIONS



Despite the fact that the instrument has been designed to work in an harsh and noisy environmental (level IV of the industrial standard IEC 801-4), it is strongly recommended to follow the following suggestions.



All the wiring must comply with the local regulations.

The supply wiring should be routed away from the power cables.


Avoid to use electromagnetic contactors, power relays and high power motors nearby.

Avoid power units nearby, especially if controlled in phase angle

Keep the low level sensor input wires away from the power lines and the output cables.

If this is not achievable, use shielded cables on the sensor input, with the shield connected to earth.

3.1 TERMINATION UNIT

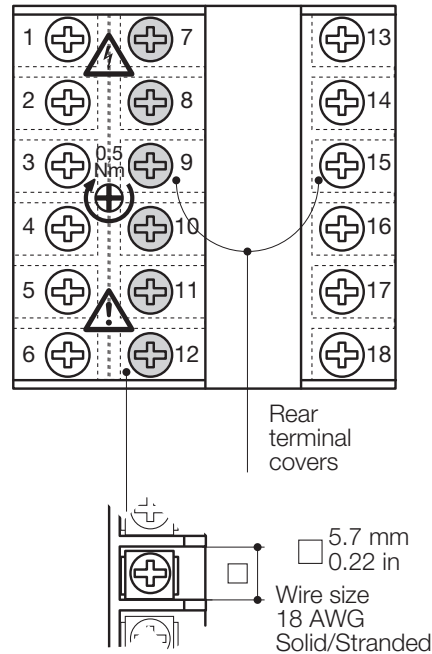


- 18 screw terminals
- Option terminals
- Holding screw 0.5 Nm
- Positive screw driver PH1
- Negative screw driver 0,8 x 4 mm


Terminals

- Pin connector \varnothing 1.4 mm 0.055 in max
- Fork-shape AMP 165004 \varnothing 5.5 mm - 0.21 in
- Stripped wire L 5.5 mm - 0.21 in

3.2 RECOMMENDED ROUTING OF WIRES

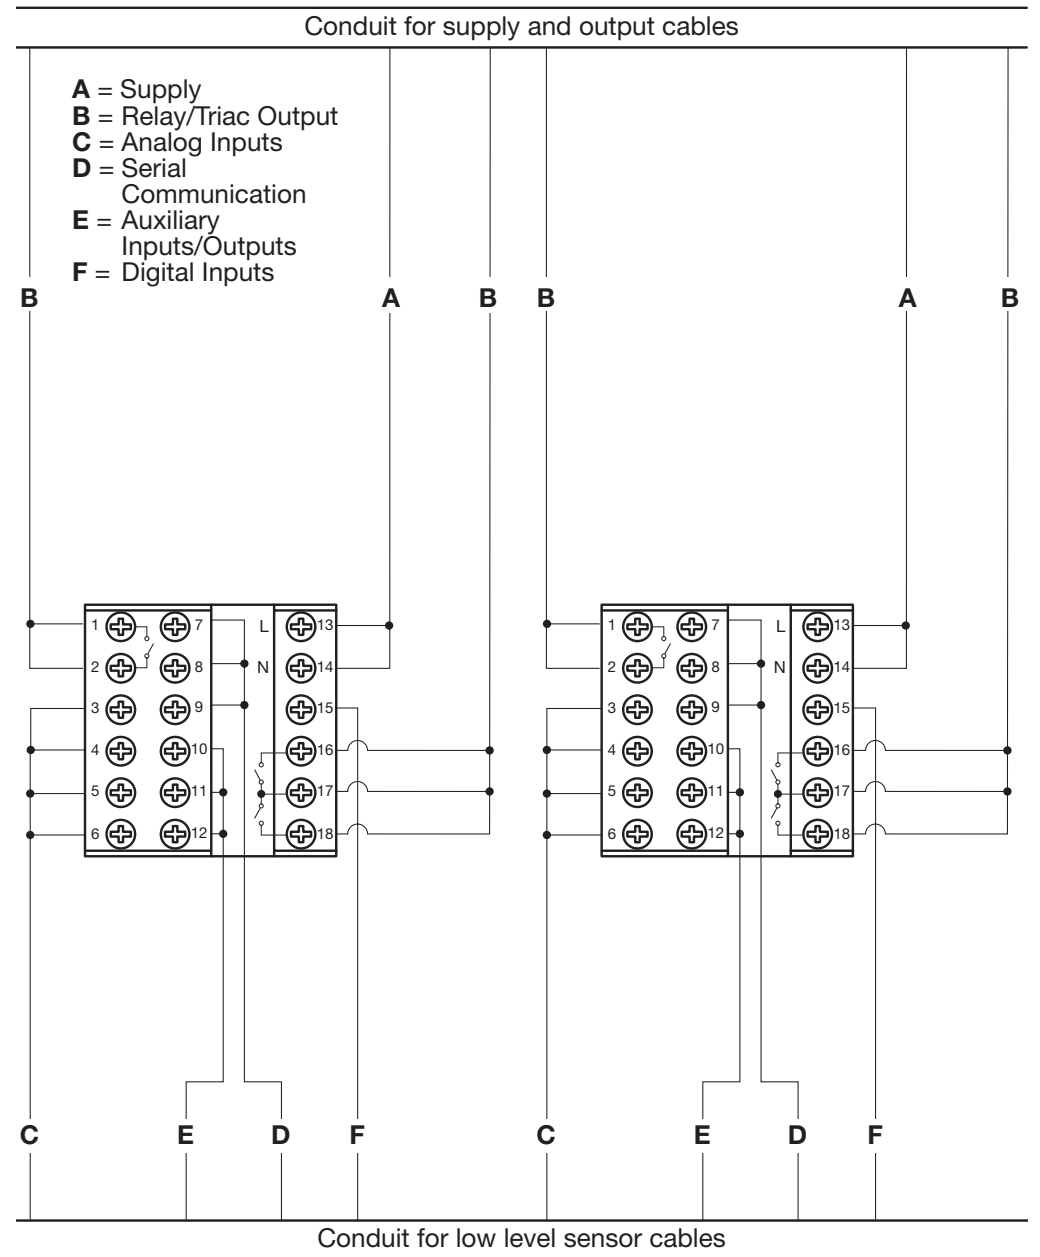



3.3.1 POWER SUPPLY

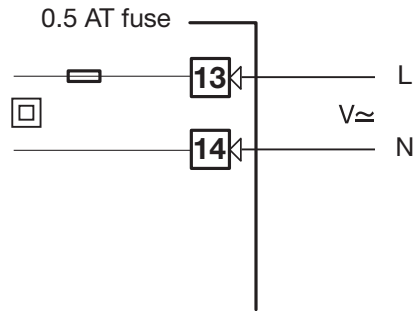


Switching power supply with multiple isolation and internal fuse

- **Standard version:**
nominal voltage:
100 - 240V \sim (-15% + 10%)
Frequency 50/60Hz
- **Low Voltage version:**
Nominal voltage:
24V \sim (-25% + 12%)
Frequency 50/60Hz
or 24V- (-15% + 25%)
- Power consumption 3W max

3.3.2 PV CONTROL INPUT

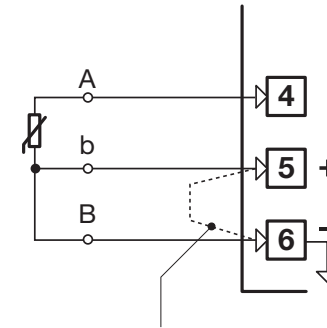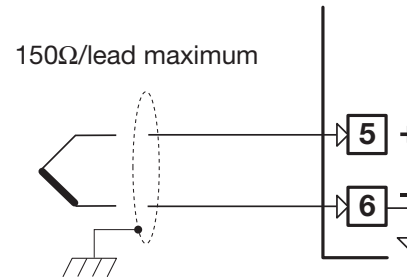

When using a 2 wire system, put a jumper between terminals 5 and 6

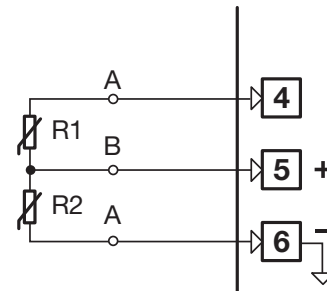**A For JLT KSR thermocouple type**

- Use always compensation cable of the correct type for the thermocouple used
- Use always compensation cable of the correct type for the thermocouple used
- The shield, if present, must be connected to a proper earth.

B For PT100 resistance thermometer

- If a 3 wire system is used, use always cables of the same diameter (1mm² min).
20Ω/lead maximum resistance
- If a 2 wire system is used, use always cables of the same diameter (1.5mm² min).


⚠ When the distance between the controller and the sensor is 15 meters, using a cable of 1.5mm² diameter, produces an error in the measure of 1°C .

B1 For ΔT (2x Pt100)


- Use wires of the same length
20Ω/lead maximum resistance.

R1 + R2 must be <320Ω


3.3.2 PV CONTROL INPUTS (cont.)

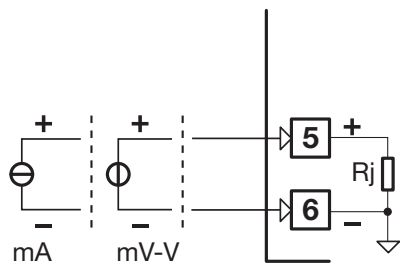**C For DC input**

Input resistance = 30Ω for mA
 Input resistance = $10M\Omega$ for mV
 Input resistance = $10K\Omega$ for Volt

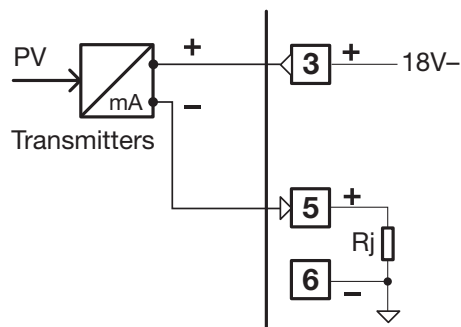
**C1 For 2 wires transmitters**

- Power supply to the transmitter
 $18V \pm 10\%$
 $30mA$ max
 Input resistance = 30Ω

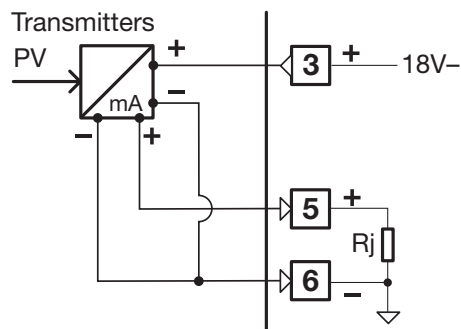
**C2 For 3 or 4 wires transmitters**

- Power supply to the transmitter
 $18V \pm 10\%$
 $30mA$ max
 Input resistance = 30Ω

3.3.3 AUXILIARY INPUTS (OPTION)

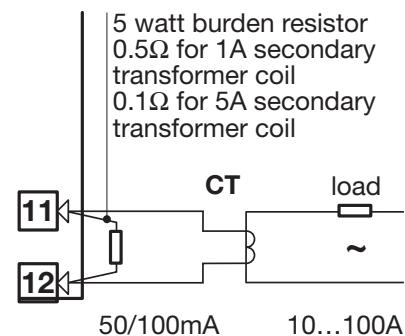**A For current transformer CT**
for the measure of the load current

- Primary coil 10A...100A
- Secondary coil 50 mA default
 $100mA$ jumper selectable


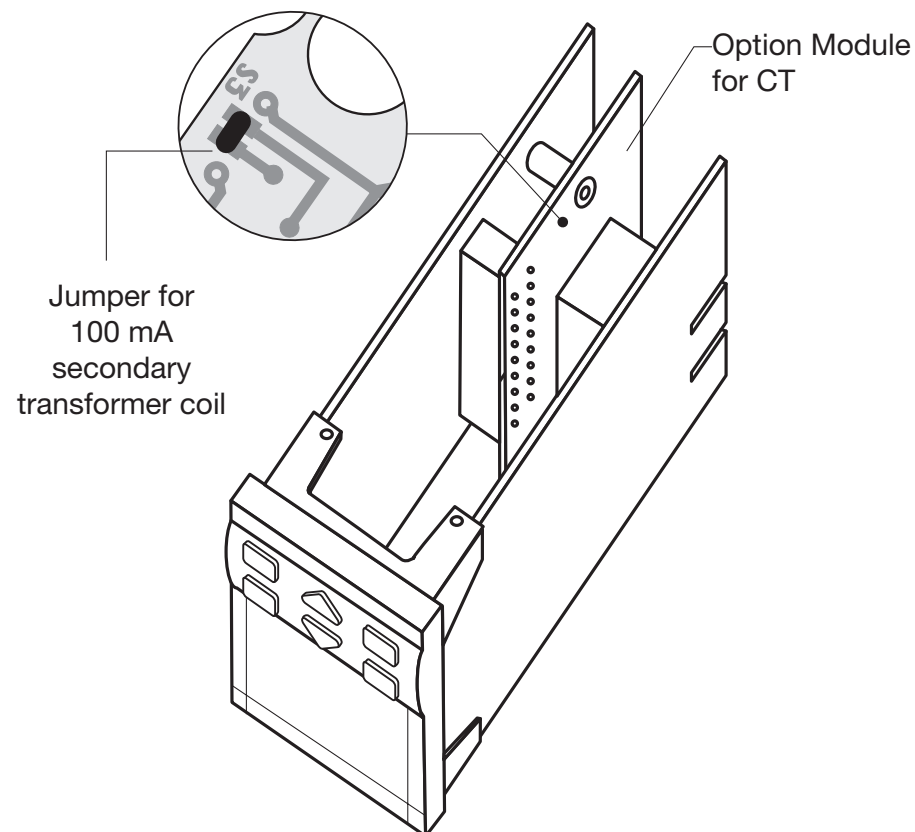


Jumper for
 100 mA
 secondary
 transformer coil

3.3.3 AUXILIARY INPUTS (cont.)



⚠ If the analogue input is provided, the terminals for the Remote Setpoint are 10(+) and 9(-)

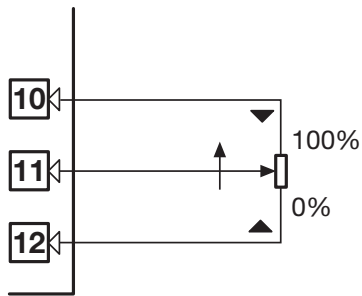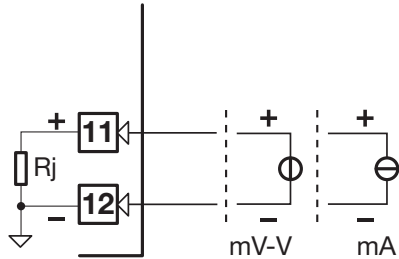


B From Remote Setpoint

Current
0/4...20mA
Input resistance = 30Ω


Voltage
1...5V, 0...5V, 0...10V
Input resistance = 300KΩ

C From Position Potentiometer

To read the real position of the motor or the valve

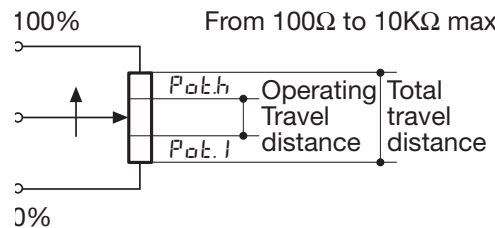

3.3.4 DIGITAL INPUTS

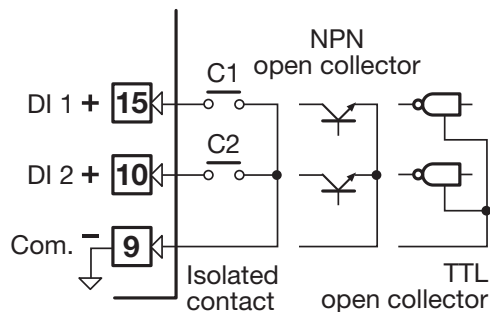

- The associated function is active when the digital input is ON (see table on page 33)
- The second digital input (DI2) is available only with the following options:
Remote Setpoint (D = 2)
Current transformer (D = 3)
Logic / analogue output (D = 4)

3.3.5 OP1 OP2 OP3 AND OP4 OUTPUTS



The functionality associated to each of the OP1 OP2 OP3 and OP4 outputs is defined during the configuration of the instrument.

The possible choices are:

		Control		Alarms			Retransm.
							PV-SP
1	Single output	OP1 Heat			OP2	OP3	OP4-C
2	Single output	OP4 Heat		OP1	OP2	OP3	
3	Single output	OP1 Heat	OP2 Cool			OP3	OP4-C
4	Heat / Cool	OP1 Heat	OP4 [1] Cool		OP2 [2]	OP3	
5	Heat / Cool	OP4 [1] Heat	OP2 Cool	OP1 [2]		OP3	
6	Valve	OP1 Raise	OP2 Lower			OP3	OP4-C


where:

OP1 - OP2	Relay or Triac output
OP3	Relay output
OP4	Analogue or Logic output
OP4-C	Analogue output

Note


- [1] In case of OP4 analogue output, its status is not visualised by any red led
[2] When the OP4 logic output is selected, the status of OP1 and OP2, as alarms, is not displayed by any red led

3.3.5-A SINGLE RELAY
OUTPUT (TRIAC)

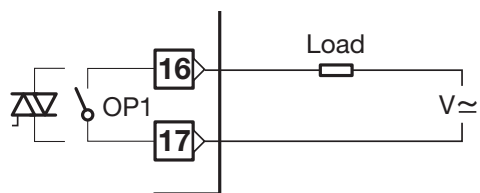


1 NO contact

3.3.5-B SINGLE LOGIC
OUTPUT (OPTION)

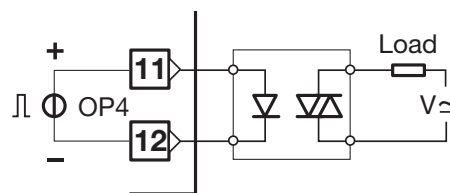


Output 0...22V- ±20% (20mA max)
galvanic isolated

3.3.5-F HEAT COOL OUTPUT RELAY (TRIAC)/LOGIC (OPTION)

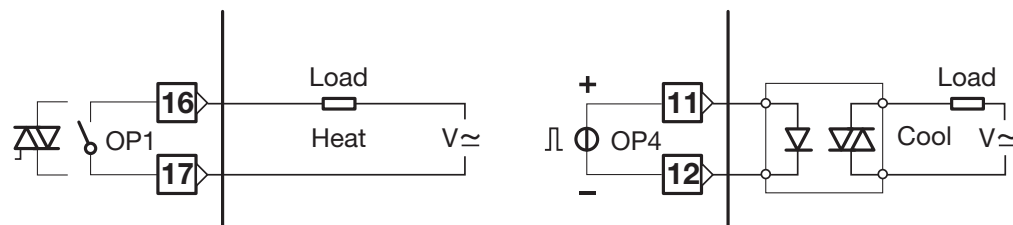


3.3.5-C SINGLE ANALOGUE
OUTPUT (OPTION)

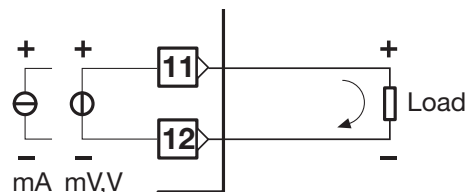


galvanic isolated
500 V~/ 1min
750Ω / 15V max if current output
500Ω / 20mA max if voltage output

3.3.5-D VALVE DRIVE OUTPUT

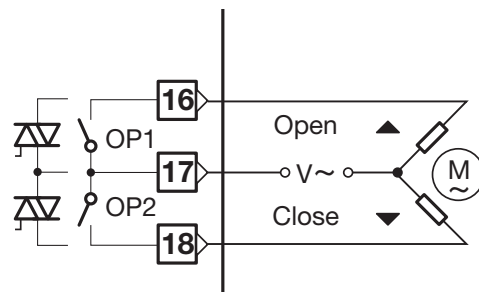


3 pole output with NO contacts
(open, stop, close)

3.3.5-G HEAT COOL OUTPUT LOGIC (OPTION)/RELAY (TRIAC)

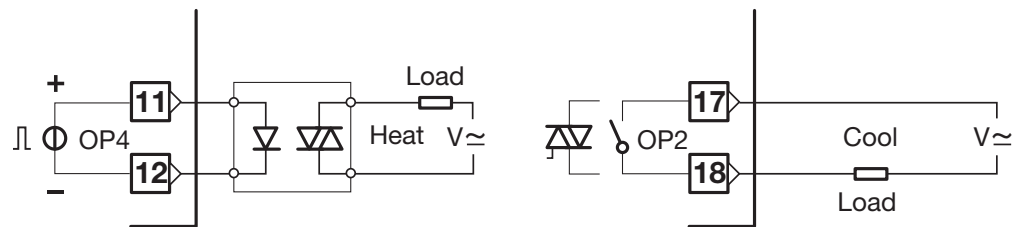


3.3.5-E HEAT COOL OUTPUT RELAY/RELAY (TRIAC/TRIAC)


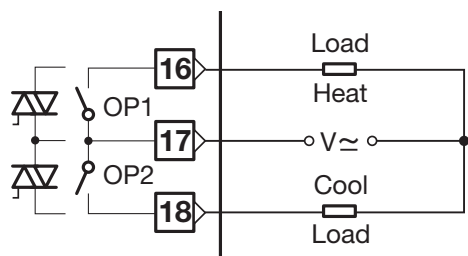


2 NO contacts


3.3.5-H HEAT COOL OUTPUT RELAY (TRIAC)/ANALOGUE (OPTION)

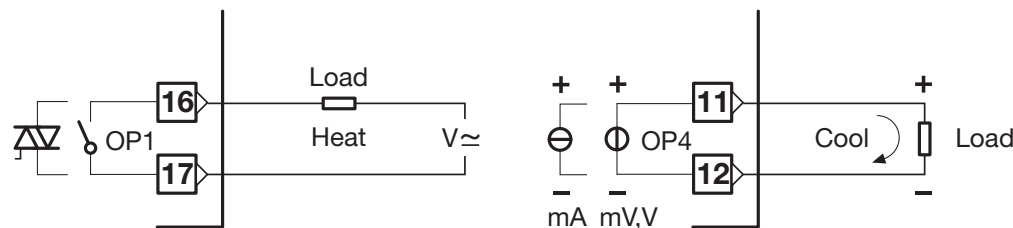

3.3.5-I HEAT COOL OUTPUT DC (OPTION)/RELAY (TRIAC)

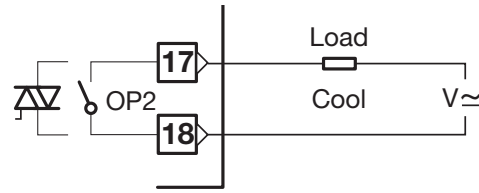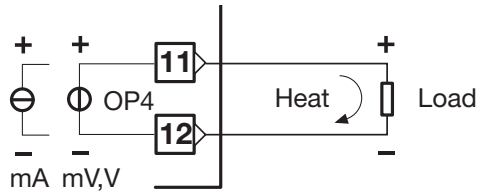


3.3.7 RETRANSMISSION OUTPUT (OPTION)

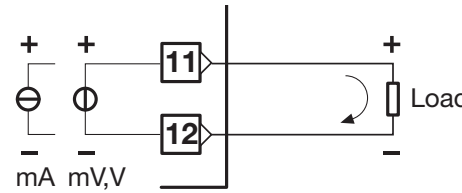


galvanic isolated
 500 V \sim / 1min
 750 Ω / 15V max if current output
 500 Ω / 20mA max if voltage output
 ⚠ The analogue/Logic output OP4 can be used for signal retransmission only if it is not used as control output.

3.3.6 ALARM OUTPUTS OP1, OP2, OP3

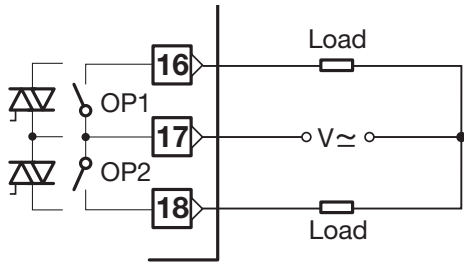


⚠ The relay/triac output OP1, OP2 and OP3, can be used as alarm outputs only if they are not used as control outputs.

2 NO contacts

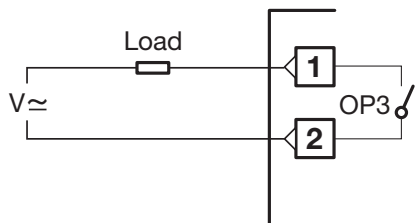

1 NO contact

3.3.8 SERIAL COMMUNICATION (OPTION)

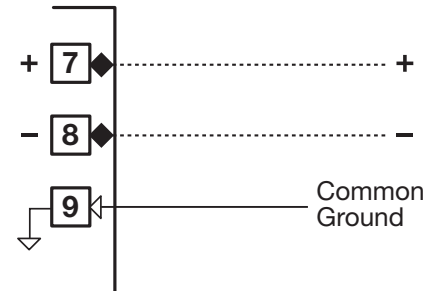


- Galvanic isolation 500V \sim /1 min
 Compliance to the EIA RS485 standard for Modbus/Jbus


⚠ Please, read the user instructions on the "M5000 controller MODBUS/JBUS protocol"

4 OPERATION

4.1.A KEYS FUNCTION AND DISPLAY IN OPERATOR MODE

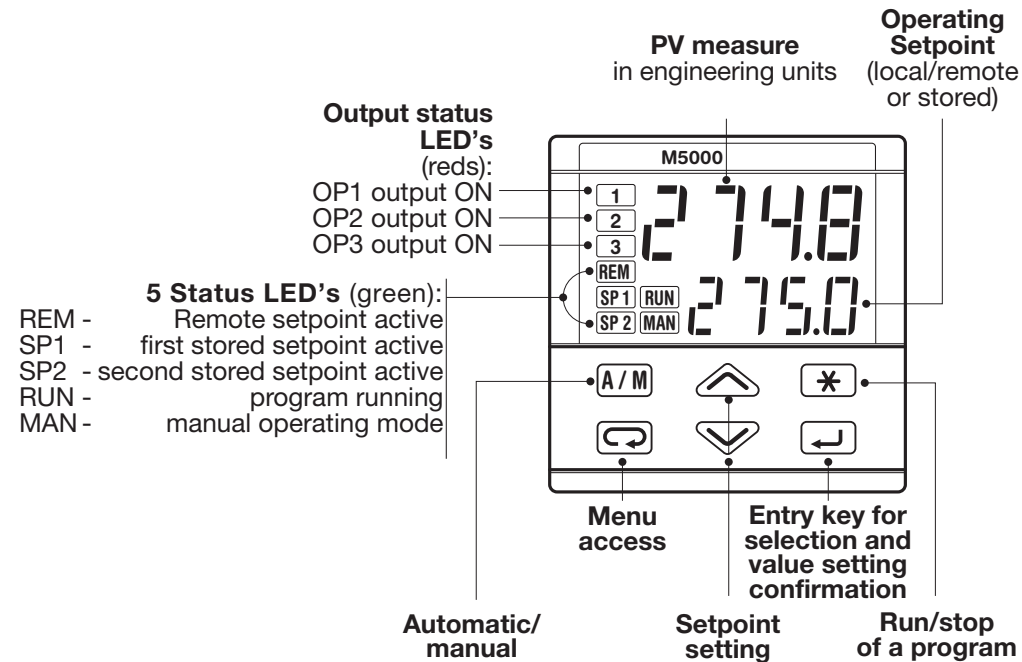


4.1.B KEYS FUNCTION AND DISPLAY IN PROGRAMMING MODE

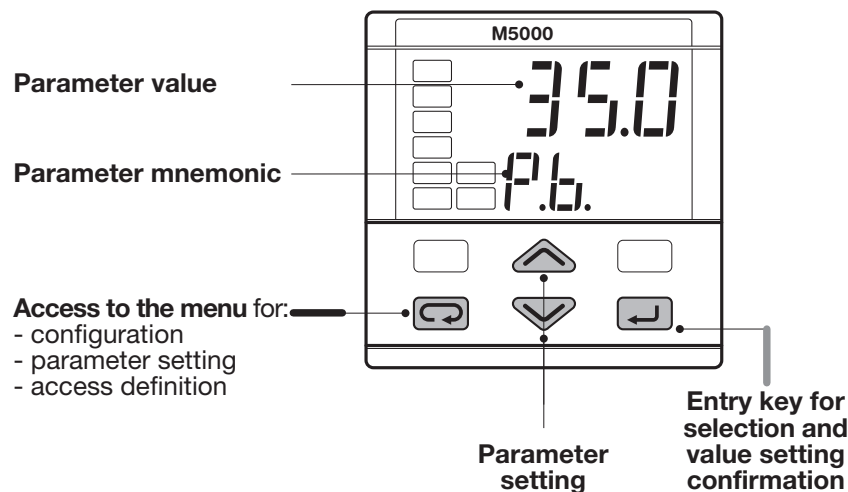

4.1.1 NUMERIC ENTRY

(i.e. the modification of the value of a stored Setpoint from 275.0 to 240.0)


Press or momentarily to change the value of 1 unit every push. Continued pressing of or changes the value, at rate that doubles every second. Releasing the button the rate of change decreases. In any case the change of the value stops when it has reached the max/min limit set for the parameter.

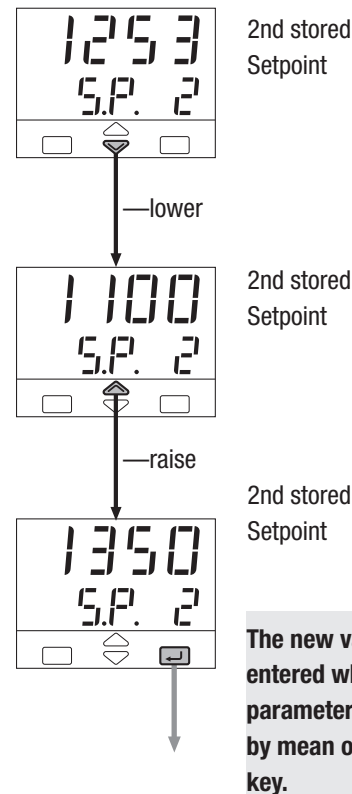


4.1.2 MNEMONIC SETTING

(Way to modified configuration page 16 / 18)

Press the or to display the next or previous mnemonic for the selected parameter. Continued pressing of or will display further mnemonics at a rate of one mnemonic every 0.5 sec. The mnemonic displayed at the time the next parameter is selected, is the one stored in the parameter.

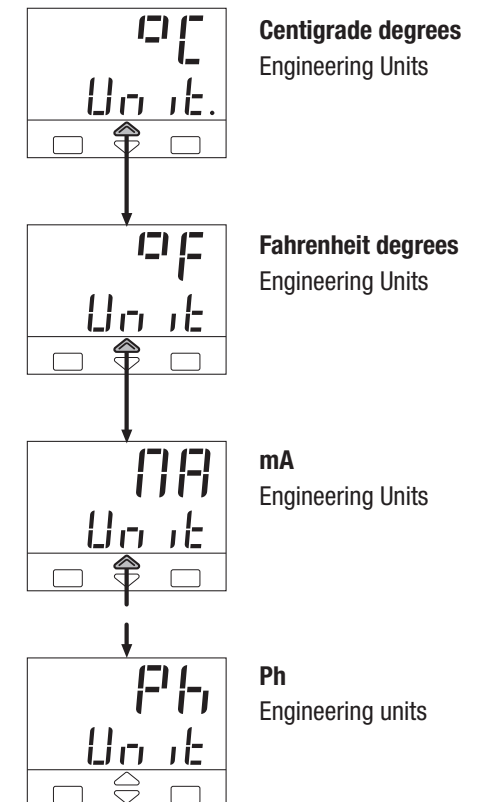

4.2 CONFIGURATION PROCEDURE

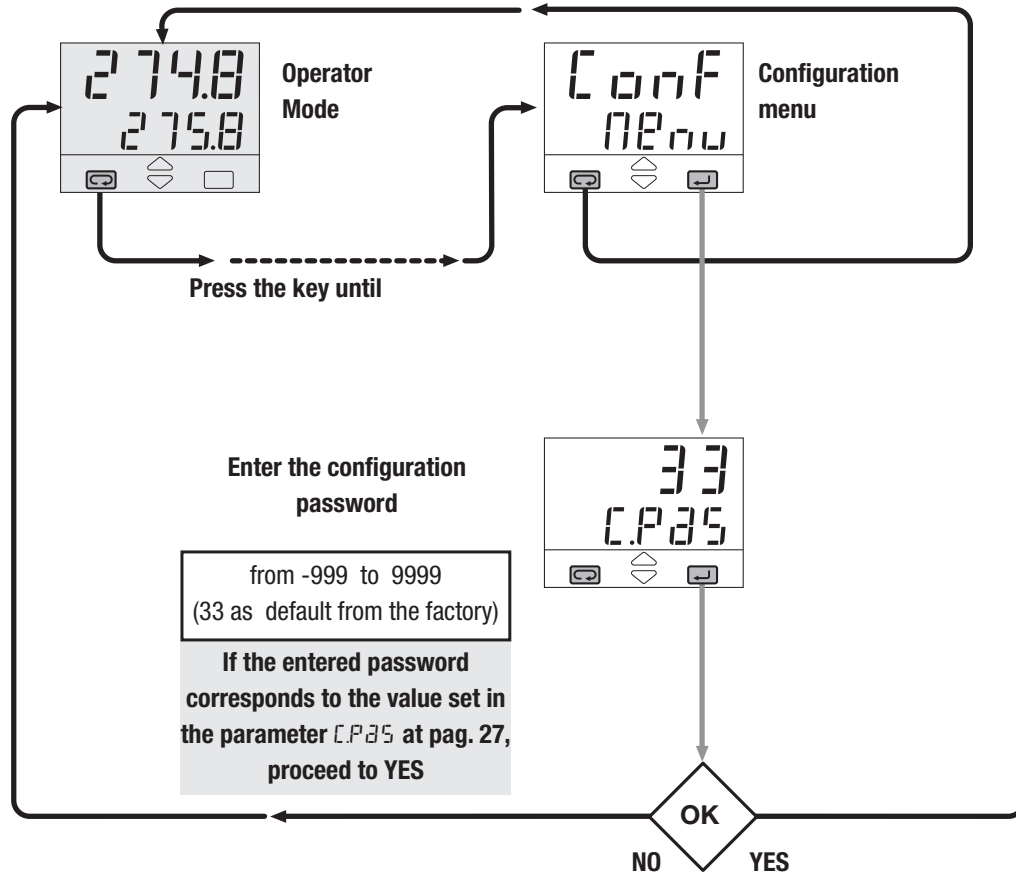


Enter the configuration password


from -999 to 9999
(33 as default from the factory)

If the entered password corresponds to the value set in the parameter CP35 at pag. 27, proceed to YES

If the configured hardware option is not installed, the display shows an hardware error message



100	Analog output not installed
101	Current transformer not installed
102	Remote Setpoint input not installed
103	Potentiometer input not installed
104	Analogue output + Remote Setpoint not installed

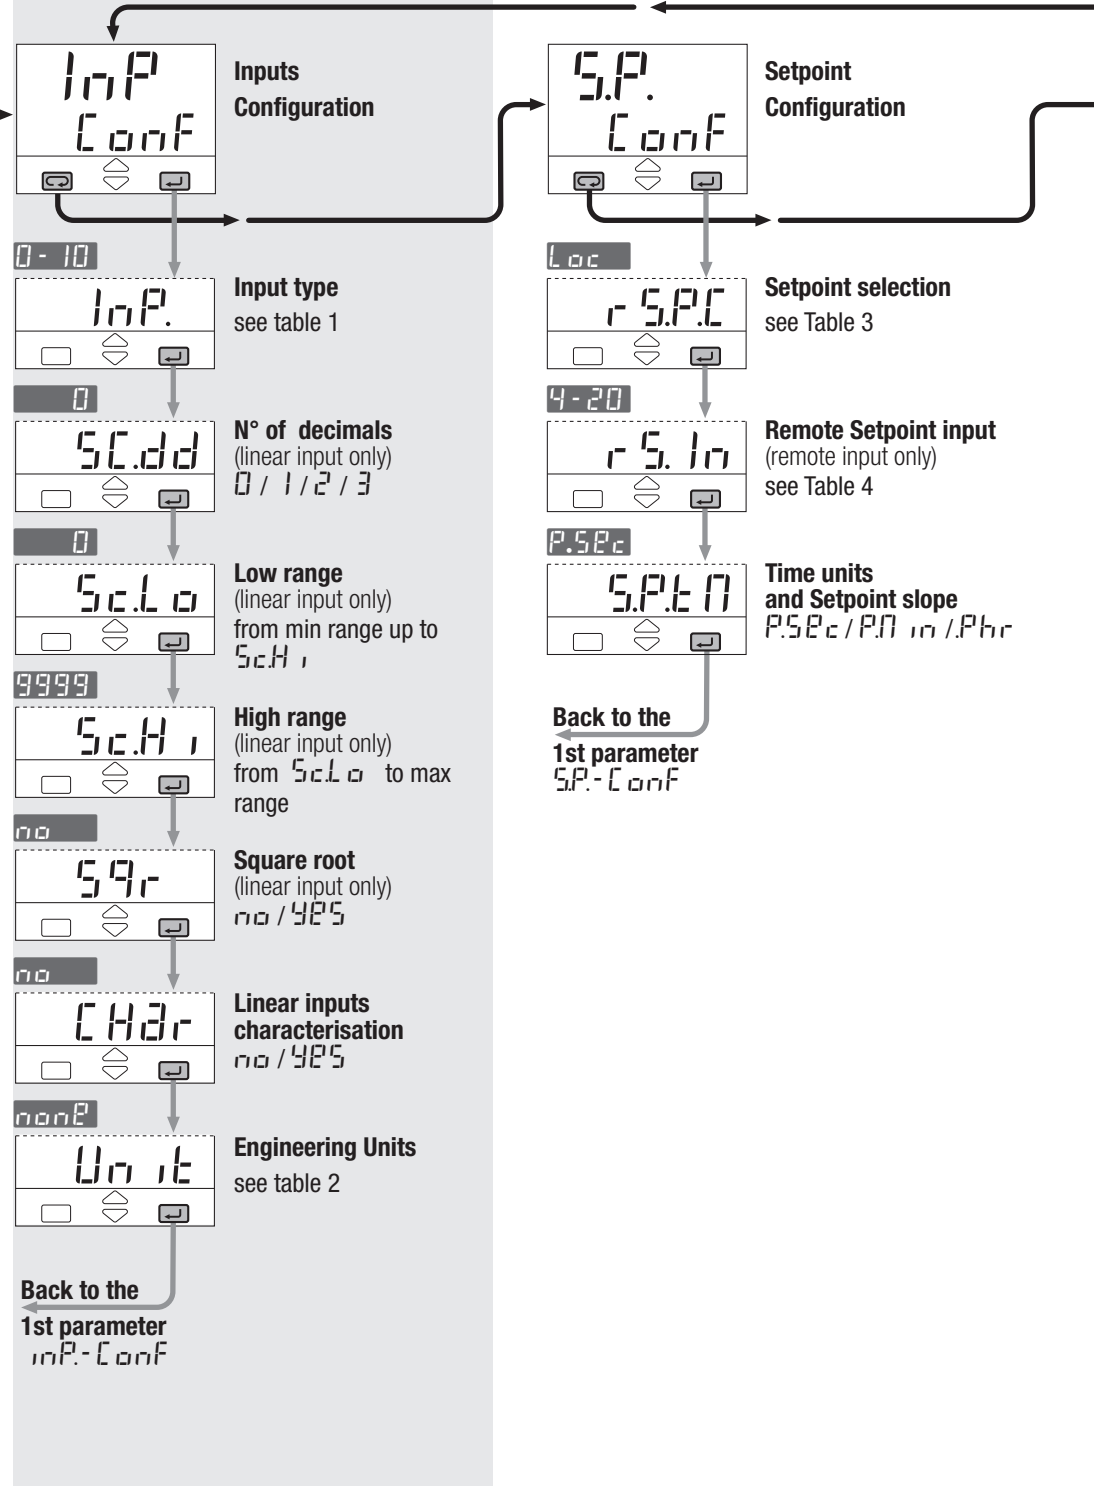

CONFIGURATION MENU

Out Conf Output Configuration

P_id.r

0.164 Type of Control see Table 5

OFF Heat control output see Table 6

5.00t Control output safety value OFF / -100...100%

nonE Retransmission output (available for DC output only) nonE / PU / SP.

4-20 Retransmission output type (available for DC output only) see Table 4

0 Retransmission low range whole range

9999 Retransmission high range whole range

OFF Cool control output see Table 7

Back to the 1st parameter of Out - Conf

L.inP Conf Digital inputs configuration

OFF DI1 function see Table 8

1L1

OFF DI2 function see Table 8

1L2

Back to the 1st parameter of L.inP - Conf

ALN Conf Alarms configuration

OFF AL1 alarm type see Table 9

AL.1 AL1 alarm type see Table 9

OP1 AL1 addressing (not available when AL1 is OFF) OP1/OP2/OP3

AL.1 AL1 addressing (not available when AL1 is OFF) OP1/OP2/OP3

no AL1 latching (not available when AL1 is OFF) no / YES

Ltch AL1 latching (not available when AL1 is OFF) no / YES

no AL1 start-up disabling (not available when AL1 is OFF) no / YES

blac AL1 start-up disabling (not available when AL1 is OFF) no / YES

OFF AL2 alarm type see Table 9

AL.2 AL2 alarm type see Table 9

OP1 AL2 addressing (not available when AL2 is OFF) OP1/OP2/OP3

AL.2 AL2 addressing (not available when AL2 is OFF) OP1/OP2/OP3

no AL2 latching (not available when AL2 is OFF) no / YES

Ltch AL2 latching (not available when AL2 is OFF) no / YES

no AL2 start-up disabling (not available when AL2 is OFF) no / YES

blac AL2 start-up disabling (not available when AL2 is OFF) no / YES

OFF AL3 alarm type see Table 9

AL.3 AL3 alarm type see Table 9

OP1 AL3 addressing (not available when AL3 is OFF) OP1/OP2/OP3

AL.3 AL3 addressing (not available when AL3 is OFF) OP1/OP2/OP3

OP1 AL3 latching (not available when AL3 is OFF) no / YES

A3.0u AL3 latching (not available when AL3 is OFF) no / YES

no AL3 start-up disabling (not available when AL3 is OFF) no / YES

Ltch AL3 start-up disabling (not available when AL3 is OFF) no / YES

no AL4 alarm type see Table 9

AL.4 AL4 alarm type see Table 9

OFF AL4 addressing (not available when AL4 is OFF) OP1/OP2/OP3


AL.4 AL4 addressing (not available when AL4 is OFF) OP1/OP2/OP3

OP1 AL4 latching (not available when AL4 is OFF) no / YES

A4.0u AL4 latching (not available when AL4 is OFF) no / YES

no AL4 start-up disabling (not available when AL4 is OFF) no / YES

Ltch AL4 start-up disabling (not available when AL4 is OFF) no / YES

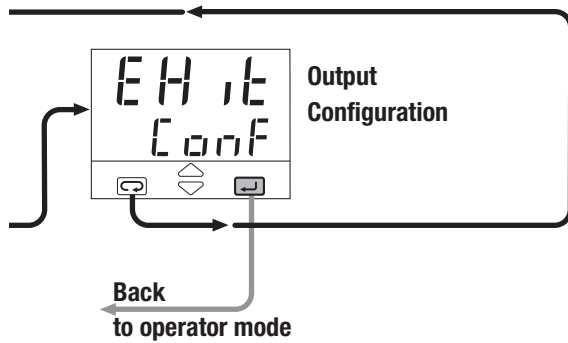

Value	Description	InP.
tc. d	0...600°C	32...1112°F
tc. l	0...600°C	32...1112°F
tc. h	0...1200°C	32...2192°F
tc. s	0...1600°C	32...2912°F
tc. r	0...1600°C	32...2912°F
tc. t	-200...400°C	-328...752°F
cust	Custom range on request	
red1	-200...600°C	-328...1112°F
red2	-99.9...300.0°C	-99.9...572.0°F
delt	-50.0...50.0°C	-58.0...122.0°F
mv	0...50 mV	Engineering units
0-5	0...5 Volt	
1-5	1...5 Volt	
0-10	0...10 Volt	
0-20	0...20 mA	
4-20	4...20 mA	

Value	Description	Unit
none	None	
c	Centigrade degrees	
f	Fahrenheit degrees	
ma	mA	
mv	mV	
v	Volt	
bar	bar	
psi	PSI	
rh	Rh	
ph	Ph	

Value	Description	rSP.
loc	Local only	
rem	Remote only	
l-r	Local/remote only	
loc.t	Local - trim	
rem.t	Remote - trim	

Value	Description	rS.in
0-5	0...5 Volt	
1-5	1...5 Volt	
0-10	0...10 Volt	
0-20	0...20 mA	
4-20	4...20 mA	


Value	Description	0.1.4
of.r	Reverse action	On - Off
of.d	Direct action	
p.add	Direct action	P.I.D.
p.dr	Reverse action	
u.dir	Direct action	Modulating valves
u.rv	Reverse action	
hcln	Linear	Heat/Cool
hcol	Oil charac.	
hch2	Water charac.	

Value	Description	H.C.O.P.
off	Not used	
r1	Relay 1	Digital signal
log	Logic	
0-5	0...5 Volt	Analogue signal
1-5	1...5 Volt	
0-10	0...10 Volt	
0-20	0...20 mA	
4-20	4...20 mA	

Value	Description	C.C.O.P.
off	not used	
r2	relay 2	Digital signal
log	Logic	
0-5	0...5 Volt	Analogue signal
1-5	1...5 Volt	
0-10	0...10 Volt	
0-20	0...20 mA	
4-20	4...20 mA	

Value	Description	IL1
off	Not used	IL2
l-r	Local/remote	
man	Auto/manual	
sp.1	1st stored Setpoint	
sp.2	2nd stored Setpoint	
pb1	Keypad lock	
sla.1	SP. slope disable	
hpu	Measure hold	
r.-h.	Run/stop of a program	

Value	Description	AL1	AL2	AL3	AL4
off	Not used				
fsh	Active high	Absolute			
fsl	Active low				
dpuh	Active high	Deviation			
dpuL	Active low				
band	Active out	Band			
htr	Active high	Heater Break			
lbd	Loop break alarm (AI1 only)				

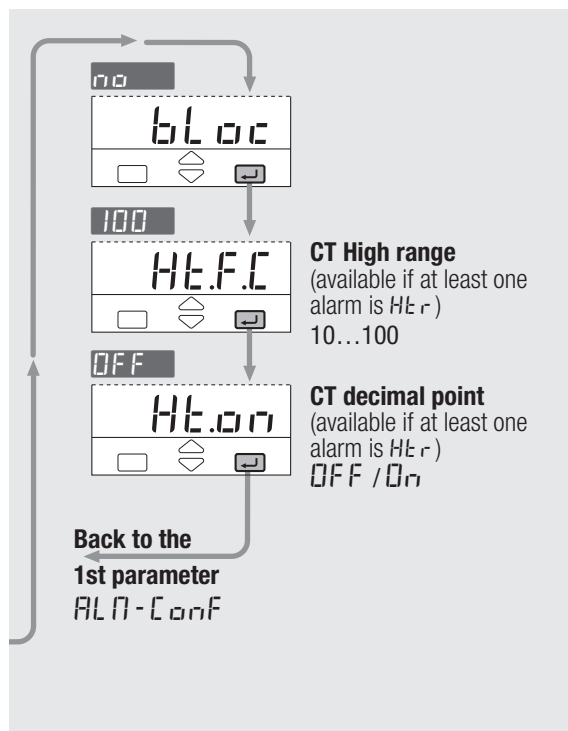

4.2.1 AL1, AL2, AL3, AL4 ALARMS CONFIGURATION

It is possible to configure up to 4 alarms: AL1, AL2, AL3, AL4 (see pag. 17), selecting, for each of them:

- A** the type and the operating condition of the alarm
(table 9 page 18)
- B** the functionality of the alarm acknowledge (latching) `Ltch`
- C** the start-up disabling (blocking) `bl oc`
- D** the physical output of the alarm
`OP1` `OP2` `OP3`


The outputs can be used for alarms if they are not used as control outputs (see par. 3.3.5 page 12)

It is possible to route up to 4 alarm to a single output (OR of the alarms).

Alarm occurrence display




This function can be enabled by the configuration software. (please read the user instruction on the "M5000 LINE MODBUS /JBUS PROTOCOL", supplied separately)

The type of alarm is presented flashing, on the front panel in alternation with the PV value.

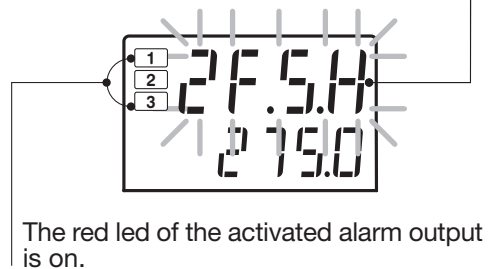


The range of the alarm threshold correspond to the whole span and it is not limited by the SP Setpoint span.

[A] OPERATING CONDITIONS

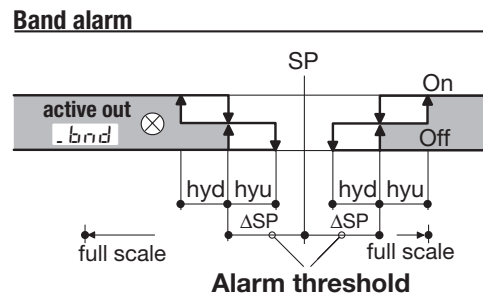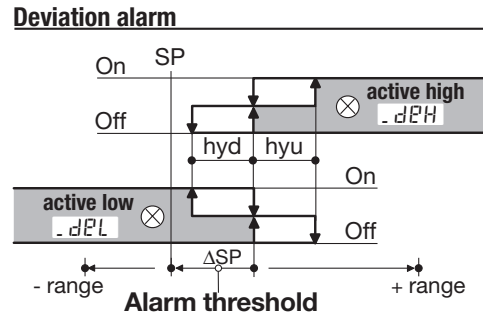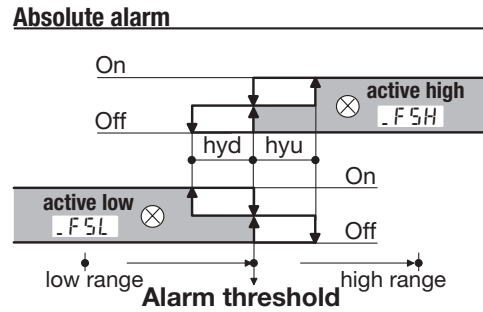



[B] ALARM ACKNOWLEDGE FUNCTION

The alarm, once occurred, is presented on the display until to the time of acknowledge. The acknowledge operation consists in pressing any key.



After this operation, the alarm leaves the alarm state only when the alarm condition is no longer present.


[C] START-UP DISABLING

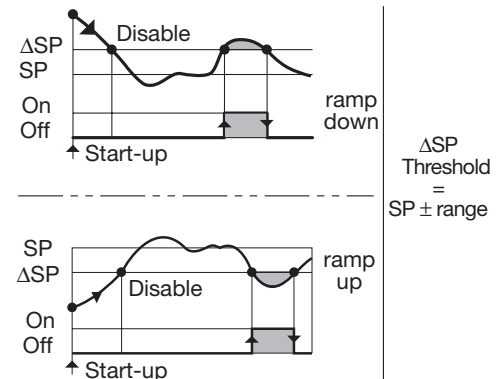

[D] LOOP BREAK ALARM LBA


When the controller connection to the sensor is discontinued or other faults are detected in the control loop, the AL1 alarm becomes active, after a predefined time of 1 to 9999 sec., from the detection of the failure. (see page 22)

The alarm state ceases when the fault condition is no longer present.

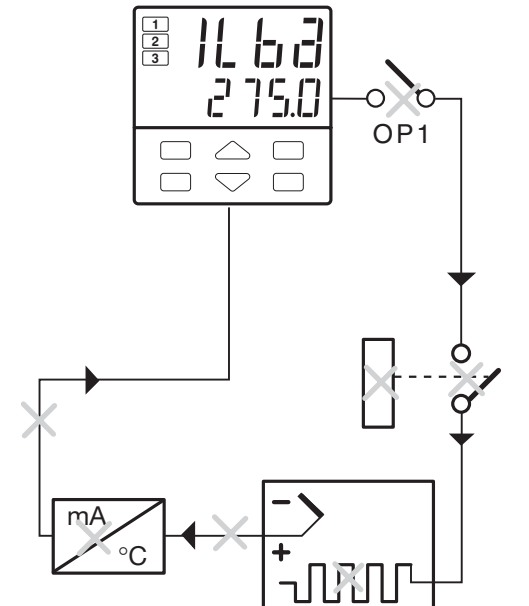

⚠ In case of ON-OFF control, the LBA alarm is not active.

4.3 PARAMETER SETTING



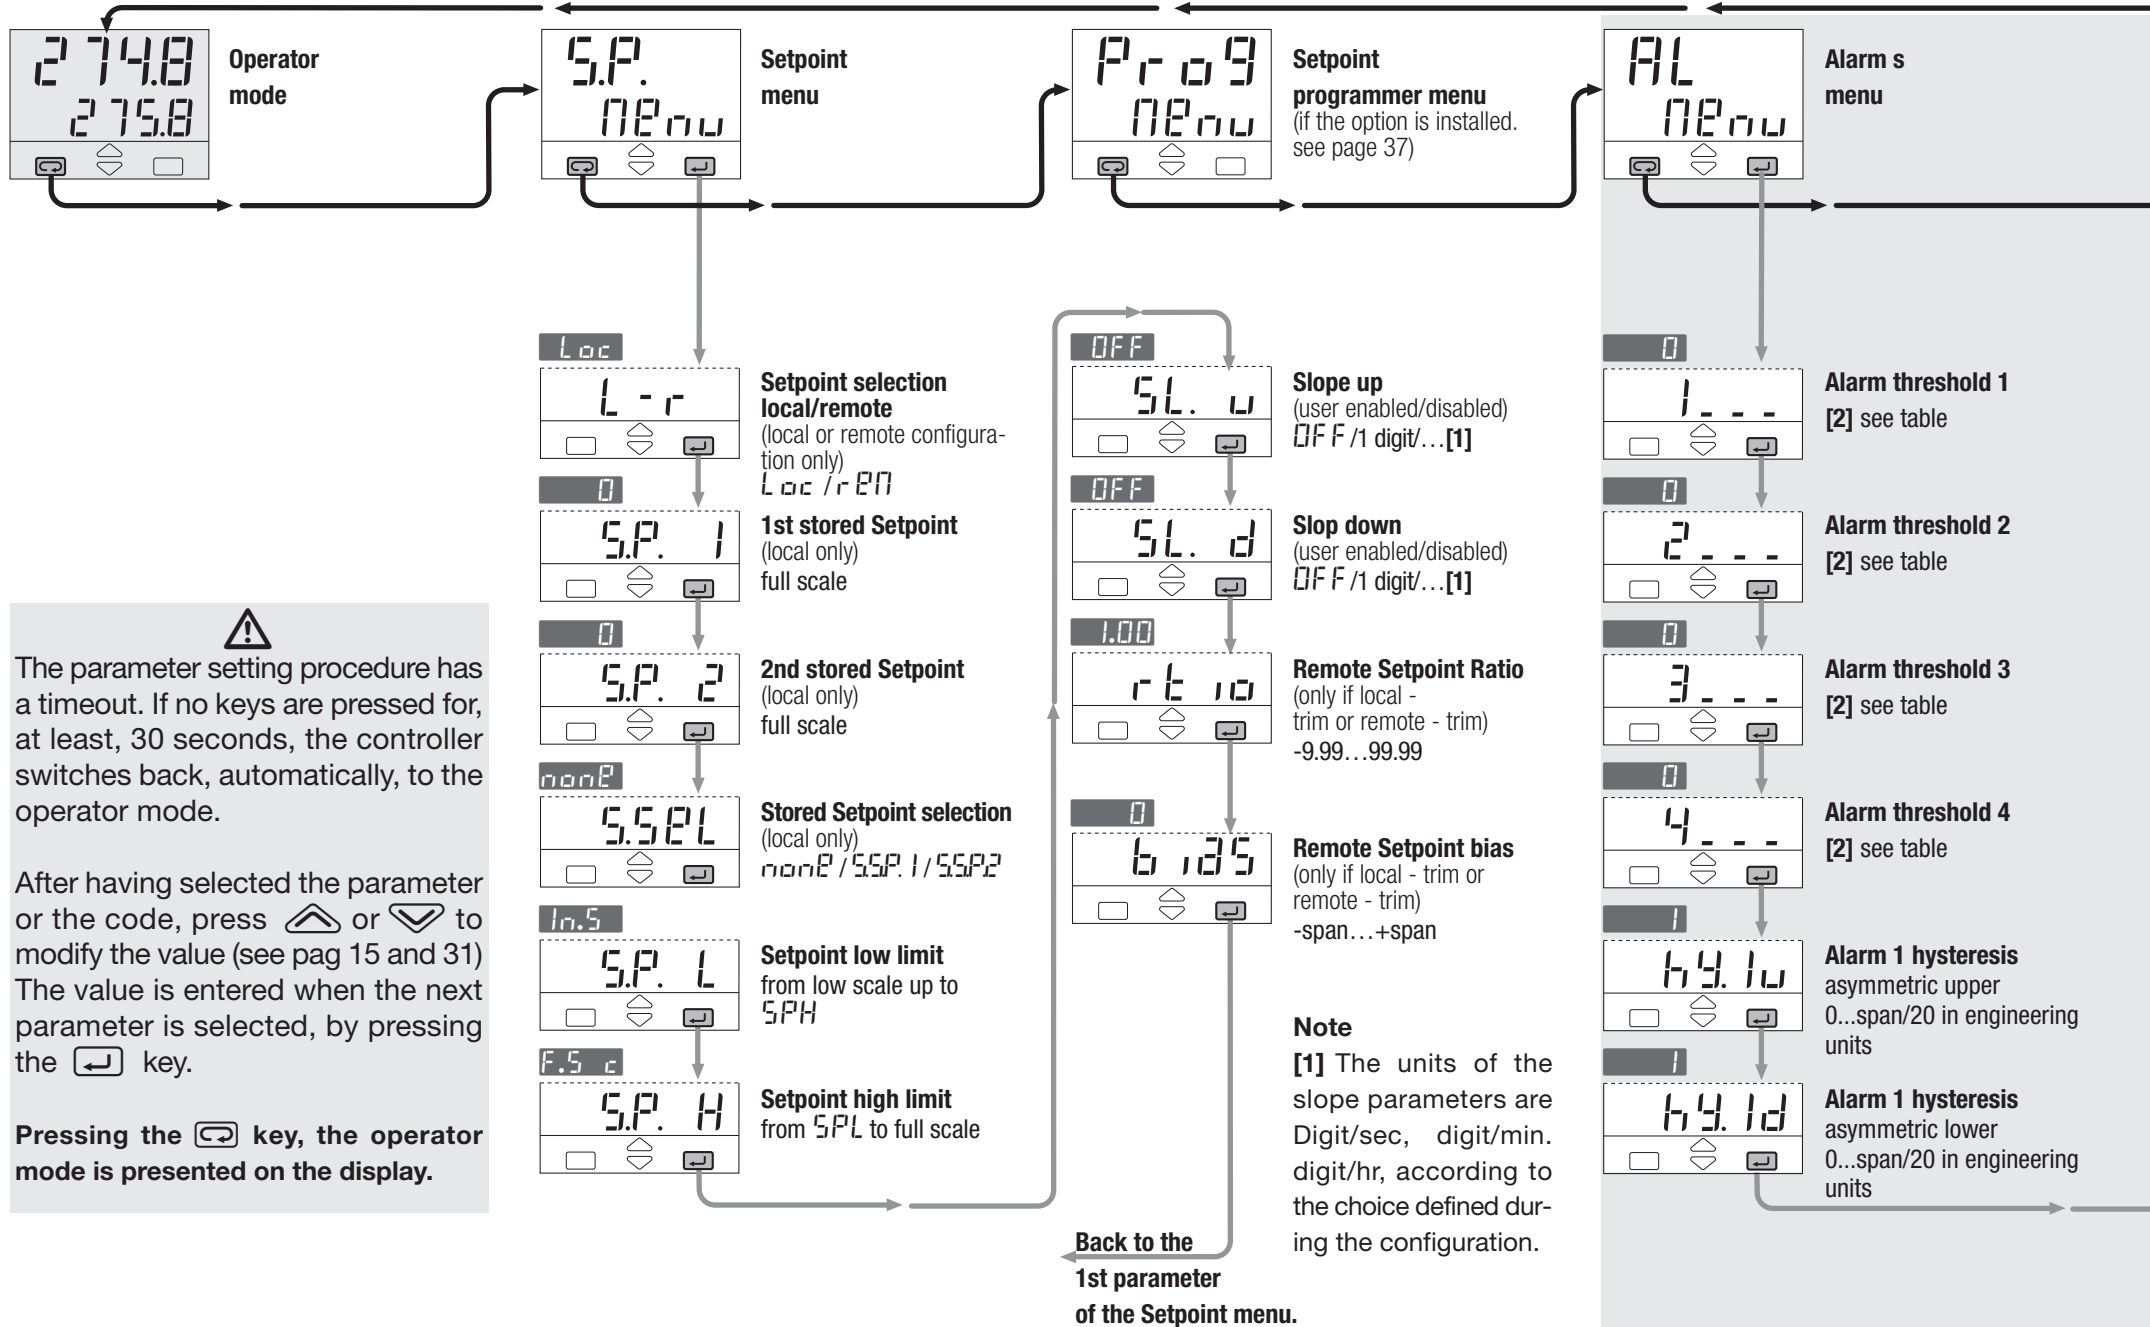


⚠
The parameter setting procedure has a timeout. If no keys are pressed for, at least, 30 seconds, the controller switches back, automatically, to the operator mode.


After having selected the parameter or the code, press or to modify the value (see pag 15 and 31) The value is entered when the next parameter is selected, by pressing the key.

Pressing the key, the operator mode is presented on the display.

PARAMETER MENU

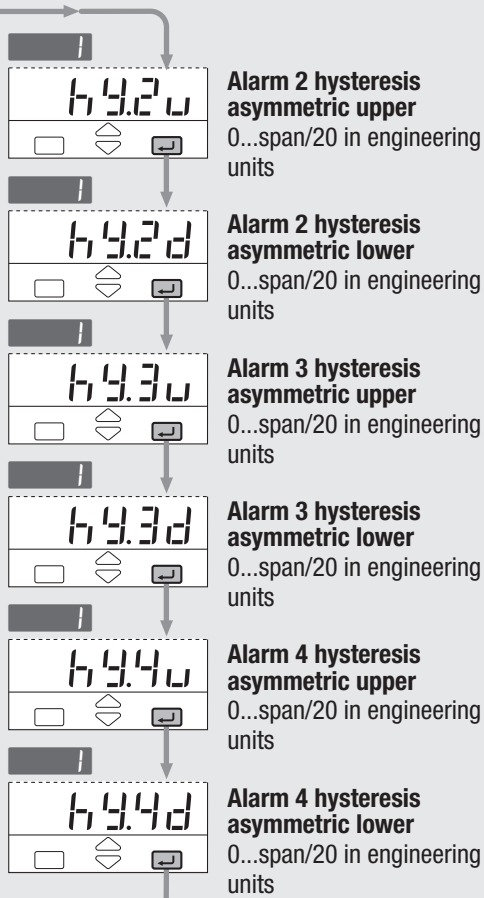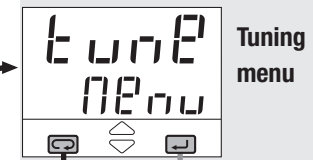


Back to the 1st parameter of the Alarms menu.

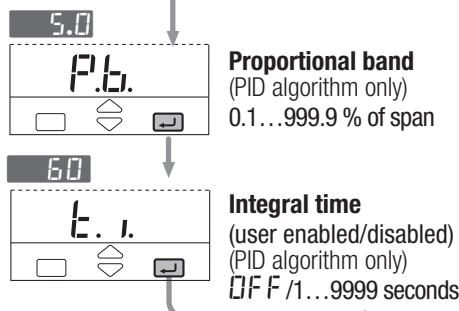


Note [2] A code, specifying the n° and the alarm type that has been configured, is displayed. At this point, the user must enter the threshold value, according to the following table.

Type and value	Mode	N° and Param.
Absolute	Active high	-FSH
	Active low	-FSL
Deviation	Active high	-dPH
	Active low	-dPL
Band full scale	Active out of band	-bnd
Load Threshold 1...100A 0.1...20A	Active high	-Htr
	Active low	-Htl
AL1 activation delay 1...9999 sec	Active high	ILb2

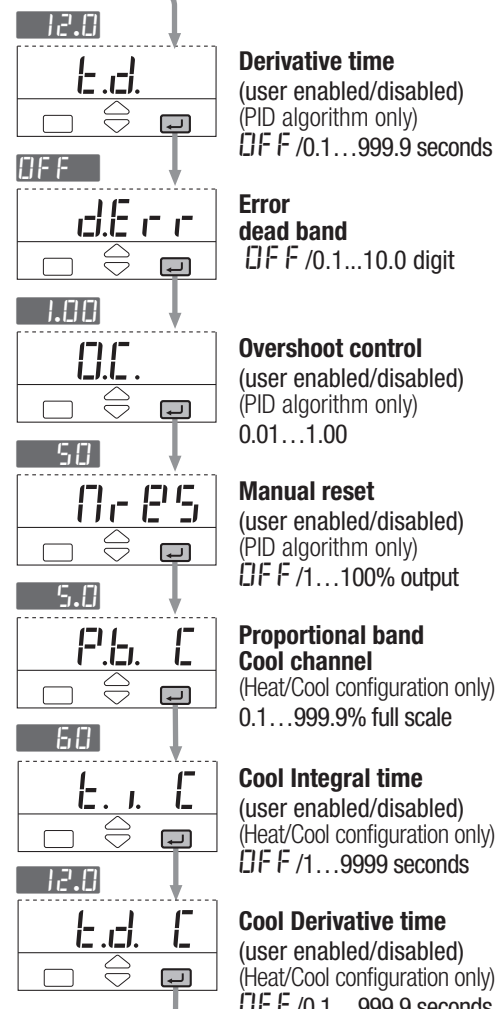


Back to the 1st parameter of the PID menu

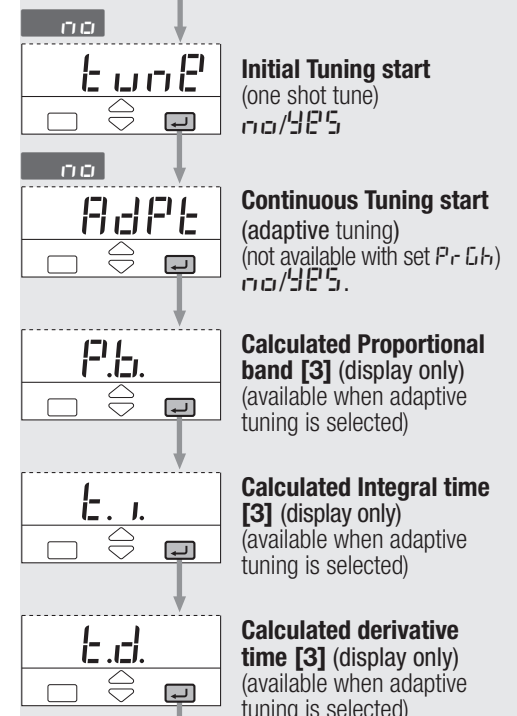

Back to the 1st parameter of the Tuning menu.

Note [3] These values are not automatically stored on the PID menu parameters P.b., t.i., t.d.

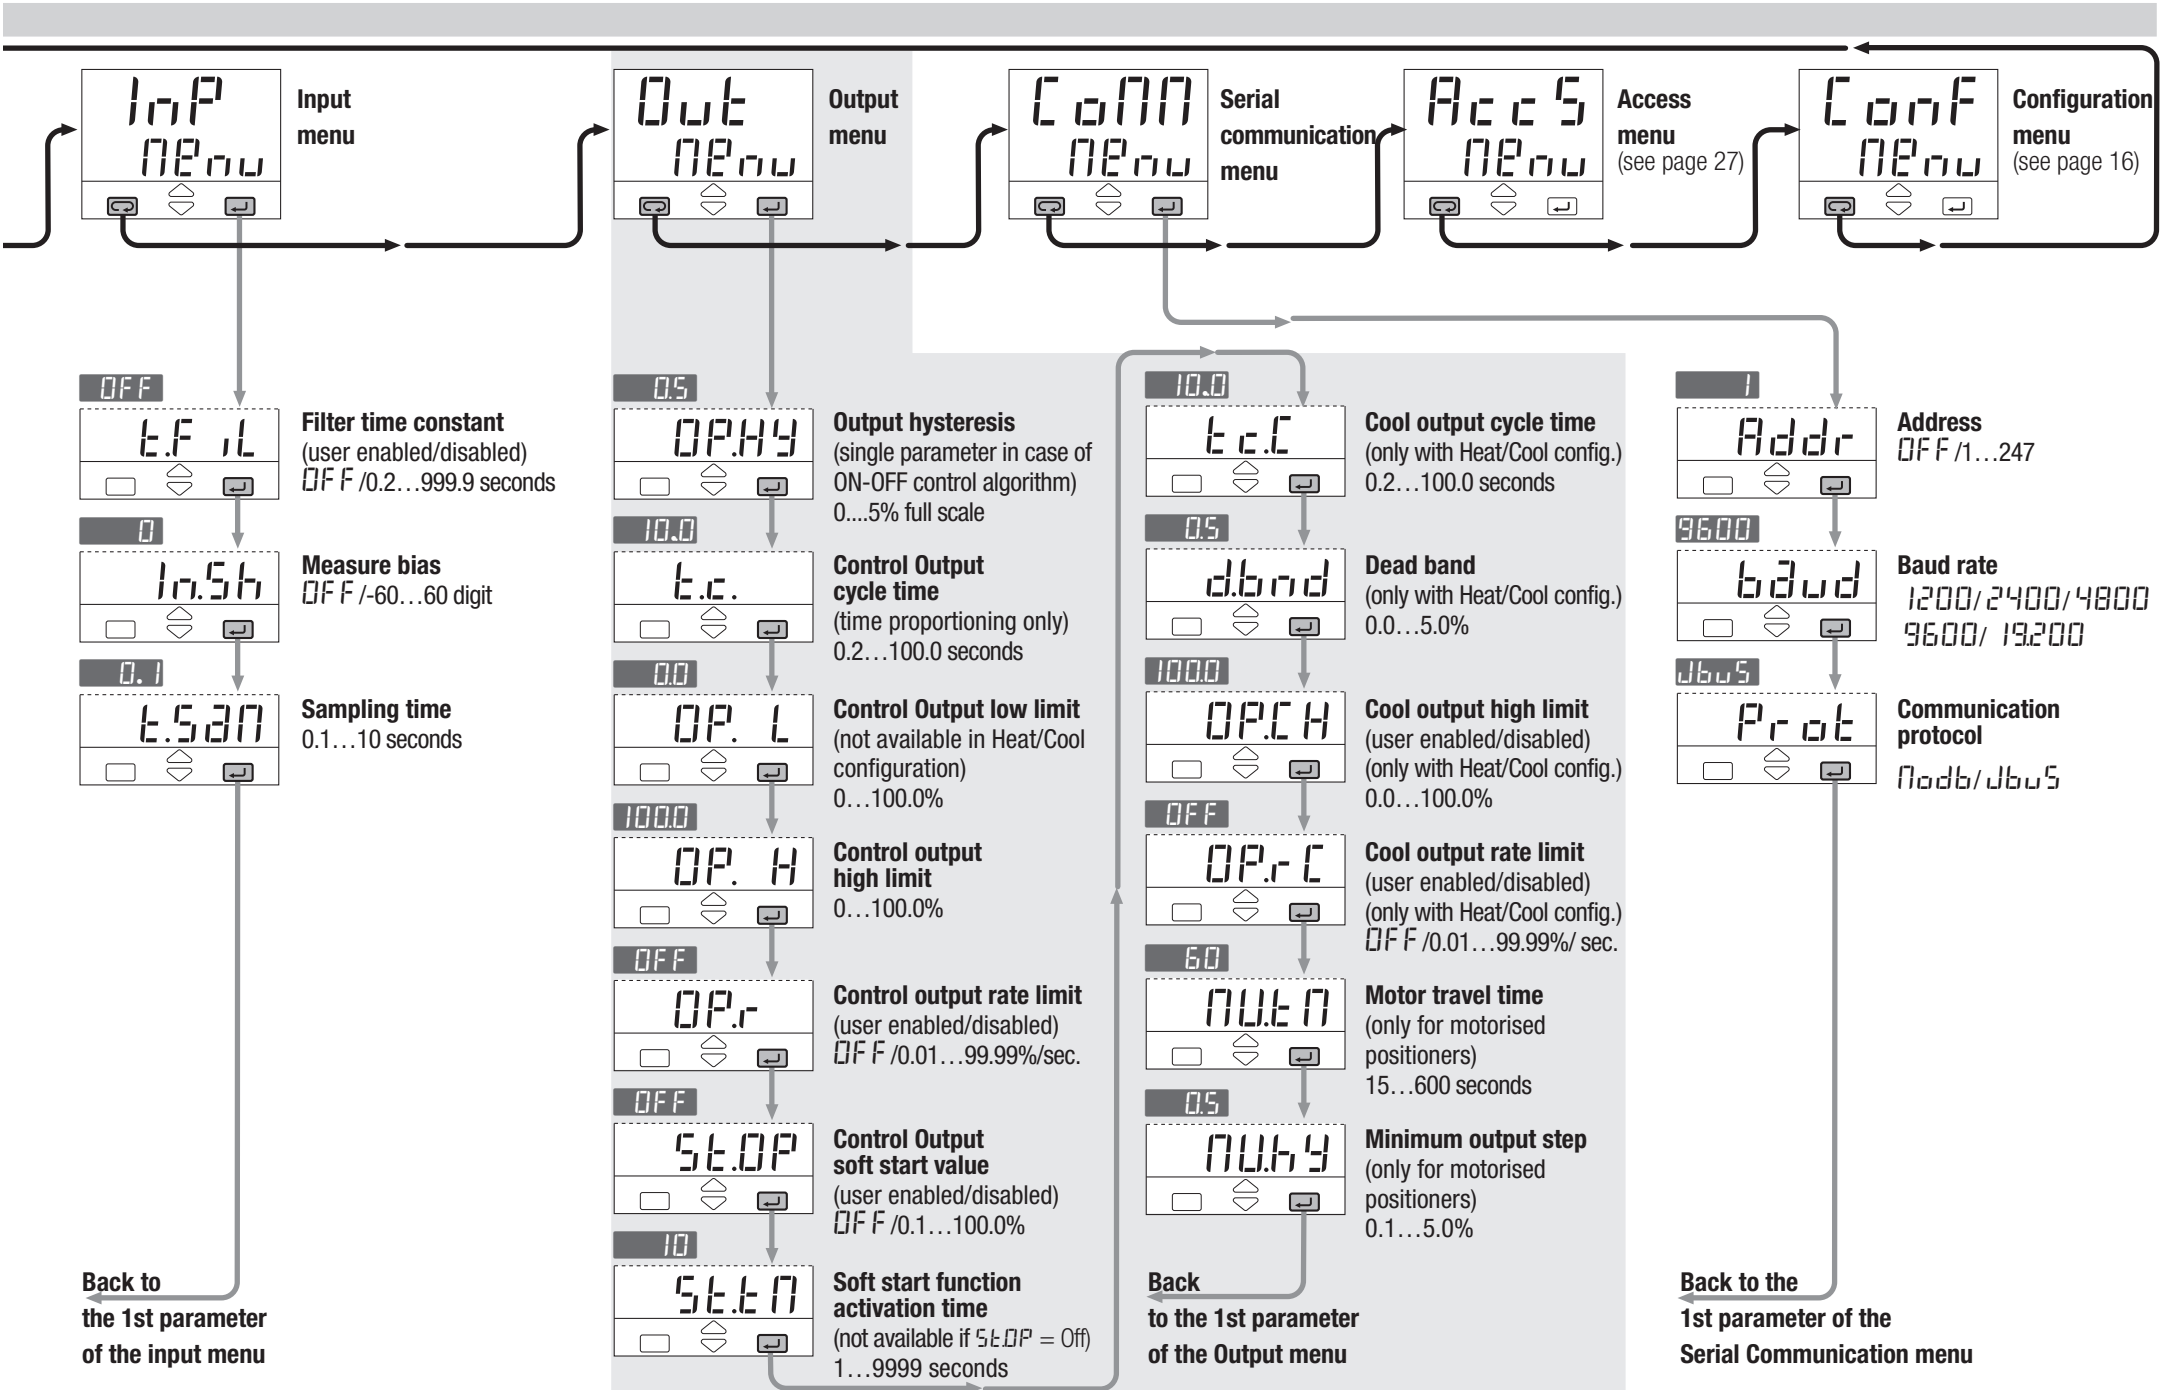

4.3.1 PARAMETERS

The controller parameters have been organised in group, according to their functionality area.

SETPOINT MENU

SP. 1

1st stored Setpoint

SP. 2

2nd stored Setpoint

Values of the two Setpoints, that are activated by mean of digital inputs, communication parameters, and keyboard. The Setpoint active is indicated by the **SP1** or **SP2** green led.

SP. L

Setpoint low limit

SP. H

Setpoint high limit

High and low limit of the Setpoint SP. The minimum span (SP 1-SP2) must be greater than 100 digit.

SL. u

Setpoint ramp up

SL. d

Setpoint ramp down

This parameter specifies the maximum rate of change of the Setpoint. Its units are: digit/sec., digit/min. and digit/hour.

When the parameter is **OFF**, this function is disabled and the new Setpoint value is reached immediately after being entered (through the keyboard, the digital inputs and the serial communication). Otherwise, the

value entered is reached according to the configured rate of change.

RE 10

Remote Setpoint Ratio


This parameter defines the maximum span of the Remote Setpoint.

6 125

Remote Setpoint Bias

It defines the low range of the Remote Setpoint, in engineering units.

Remote Setpoint Bias and Ratio

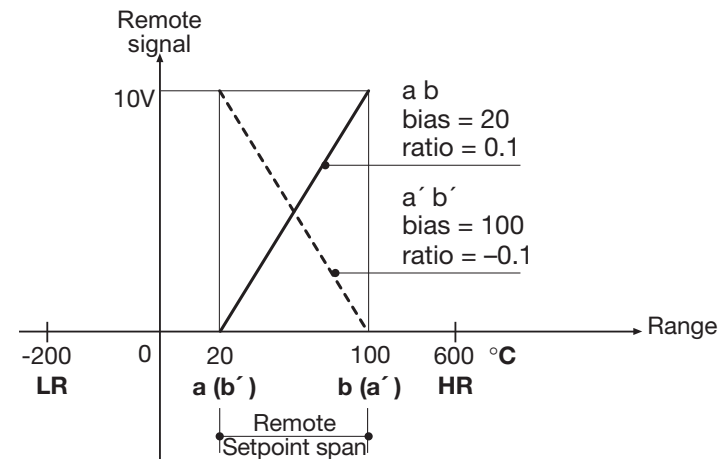

- PV = Process variable
- LR = PV low limit
- HR = PV high limit
- SR = Remote Setpoint
- a (a) = SR starting point
- b (b) = SR ending point

If SR starting point is **lower** then the ending point, both expressed in engineering units:

b_{start} = starting point = a

$$r_{\text{trim}} = \frac{b - a}{HR - LR}$$

Example:

$b_{\text{start}} = 20$

$r_{\text{trim}} =$

$$\frac{100 - 20}{600 - (-200)} = \frac{80}{800} = 0.1$$

If SR starting point is **higher** then the ending point, both expressed in engineering units

b_{start} = starting point = a'

$$r_{\text{trim}} = \frac{b' - a'}{HR - LR}$$

Example:

$b_{\text{start}} = 100$

$r_{\text{trim}} =$

$$\frac{20 - 100}{600 - (-200)} = \frac{-80}{800} = -0.1$$

Working Setpoint (SP) as combination of Local Setpoint (SL) and remote signal

Setpoint type *Local*
(table 3, page 18)

$$SP = SL + (r_{\text{trim}} \cdot REM) + b_{\text{start}}$$

Setpoint type *Remote*
(table 3, page 18)

$$SP = REM + (r_{\text{trim}} \cdot SL) + b_{\text{start}}$$

SIGN = Remote signal percentage

SPAN = HR-LR

$$REM = \frac{SIGN * SPAN}{100}$$

Examples:

Local Setpoint (SL) with an external Trim with multiplying coeff. of 1/10:

Setpoint type = *Local*

$r_{\text{trim}} = 0.1$

$b_{\text{start}} = 0$

Remote Setpoint (SR) with an internal Trim with multiplying coeff. of 1/5:

Setpoint type = *Remote*

$r_{\text{trim}} = 0.2$

$b_{\text{start}} = 0$

Remote Setpoint range equal to the Input range:

Setpoint type = *Local*

$r_{\text{trim}} = 1$

$b_{\text{start}} = LR$

$SL = 0$

ALARM MENU

(see page 19)

PID MENU

P.B.

Proportional Band

P.B. C

Cool Proportional Band

This parameter specifies the proportional band coefficient that multiplies the error (SP - PV)

I. I.

Integral Time

I. I. C

Cool integral Time

It is the integral time value, that specifies the time required by the integral term to generate an output equivalent to the proportional term
When *OFF* the integral term is not included in the control algorithm.

D. D.

Derivative Time

D. D. C

Cool Derivative Time

It is the derivative term coefficient that specifies the time required by the proportional term P to reach the level of D.
When *OFF* the derivative term is not included in the control algorithm.

4.3.1 PARAMETERS (cont.)

0.0 Overshoot control

(Automatically disabled when the adaptive tuning is running)

This parameter specifies the span of action of the overshoot control. Setting lower values ($1 \rightarrow 0.01$) the overshoot generated by a Setpoint change is reduced. The overshoot control doesn't affect the effectiveness of the PID algorithm.

Setting 1, the overshoot control is disabled.

0.1 Manual reset

This term specifies the value of the control output when $PV = SP$, in a PD only algorithm (lack of the Integral term).


TUNING

Two tuning method are provided:

- Initial one shoot **Autotuning**
- Continuous, self learning **Adaptive Tuning**

When the **Autotuning** is started, the controller generates a rapid burst of ON - OFF transition and monitors the response, in order to calculate the optimal PID terms parameters. Once calculated the terms values are immediately used in the control algorithm. (a minimum error of 5% of span is needed to start the Autotuning)

One shot initial autotuning

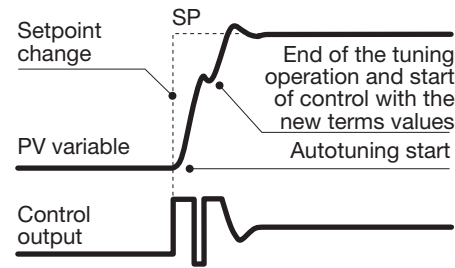


The self-learning **adaptive autotune**, developed by ASCON, is not intrusive. It doesn't affect the process, at all, during the phase of calculation of the optimal terms parameters.

It is particularly suitable for controlling process whose control characteristics change with time or are not linear in relation to the Setpoint values.

It doesn't require any operation by the user. It is simple and works fine: it samples continuously the process response to the various perturbations, determining the frequency and the amplitude of the signals. On the basis of this data and their statistical values, stored in the instrument, it modifies automatically the PID term parameters.

It is the ideal for all applications where it is required to change continuously the PID terms parameters, in order to adjust the PID to the changes of the process dynamic conditions.

Continuous adaptive tune

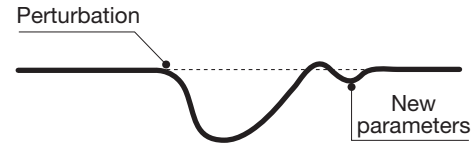

In case of power off with the Adaptive Tune enabled, the values of the PID terms parameters are stored, in order to be reused at the next power on.


At power on the Adaptive Tune starts automatically.

INPUT MENU

0.0 Input filter

Time constant, in seconds, of the RC input filter on the PV input. When this parameter is **0.0** the filter is bypassed.

Filter reponse

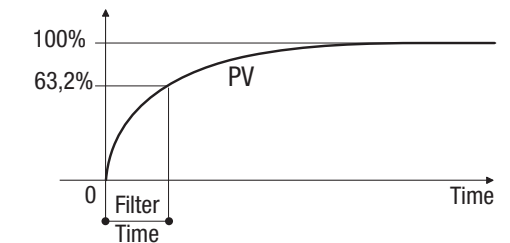

0.5 Measure Bias


This value is added to the measured PV input value. Its effect is to shift the whole PV scale of its value (± 60 digits).

0.5 Sampling Time

Sampling time, in seconds, of the instrument. This parameter is normally used when controlling slow process, increasing the sampling time from 0.1 to 10 seconds.

OUTPUT MENU

OP.HY Control output hysteresis

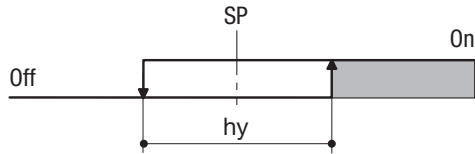

Control output hysteresis span, hy, set in % of the full scale.

OP.L Control output low limit

OP.H Control output high limit

It's the cycle time of the time proportioning control output. The PID control output is provided by the pulse width modulation of the waveform.

OP.L Control Output low limit

It specifies the minimum value of the control output signal. It is applied in manual mode, too.

OP.H Control output high limit

OP.LH Cool output high limit

It specifies the maximum value the control output can be set. It is applied in manual mode, too.

OP.r Heat output maximum rate

OP.rC Cool output maximum rate


This value, specified in %/seconds, with range from 0.01 to 99.99%/sec. provides the maximum rate of change of the output. When set to **OFF** this function is disabled.

SE.OP Soft start of the control output

It specifies the value at which the control output is set during the start up phase.

SE.LT Soft start time


This value specifies the time the start up phase lasts. The start up phase starts at power up of the controller.

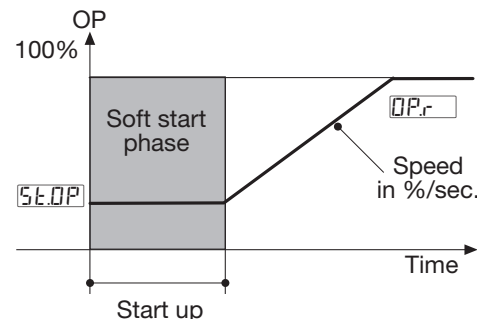

db.nd Heat/Cool deadband

This parameter specifies the width of the deadband between the Cool and the Heat channel

Heat / Cool algorithm

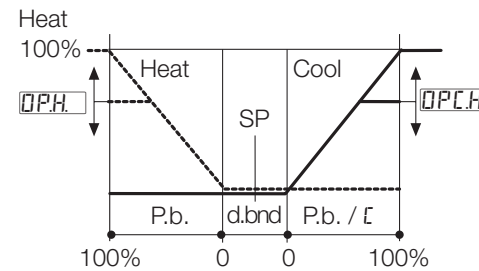

..... Heat output
 ——— Cool output

TR.LT Travel time

It provides the time required to the motor positioner to go from the 0% position to 100%

TR.HY Minimum step

It specifies the minimum allowed time of activation of the output to a motor positioner that produces a sensible effect. It is related to the deadband of the positioner

SERIAL COMMUNICATION MENU

Addr Controller address

The address range is from 1 to 247 and must be unique for each controller on the communication bus to the supervisor. When set to **OFF** the controller is not communicating

baud Baud rate

It provides the baud rate in the range from 1200 to 19.200 bit/sec.

Prot Communication protocol

Modb/rtu5

This Slave protocol allows the supervisor to read and write (when it is possible) all the parameters of the controller.


ACCESS MENU

(see page 27)

CONFIGURATION MENU

(see page 16)

4.4 ACCESS LEVEL - PASSWORD - CALIBRATION

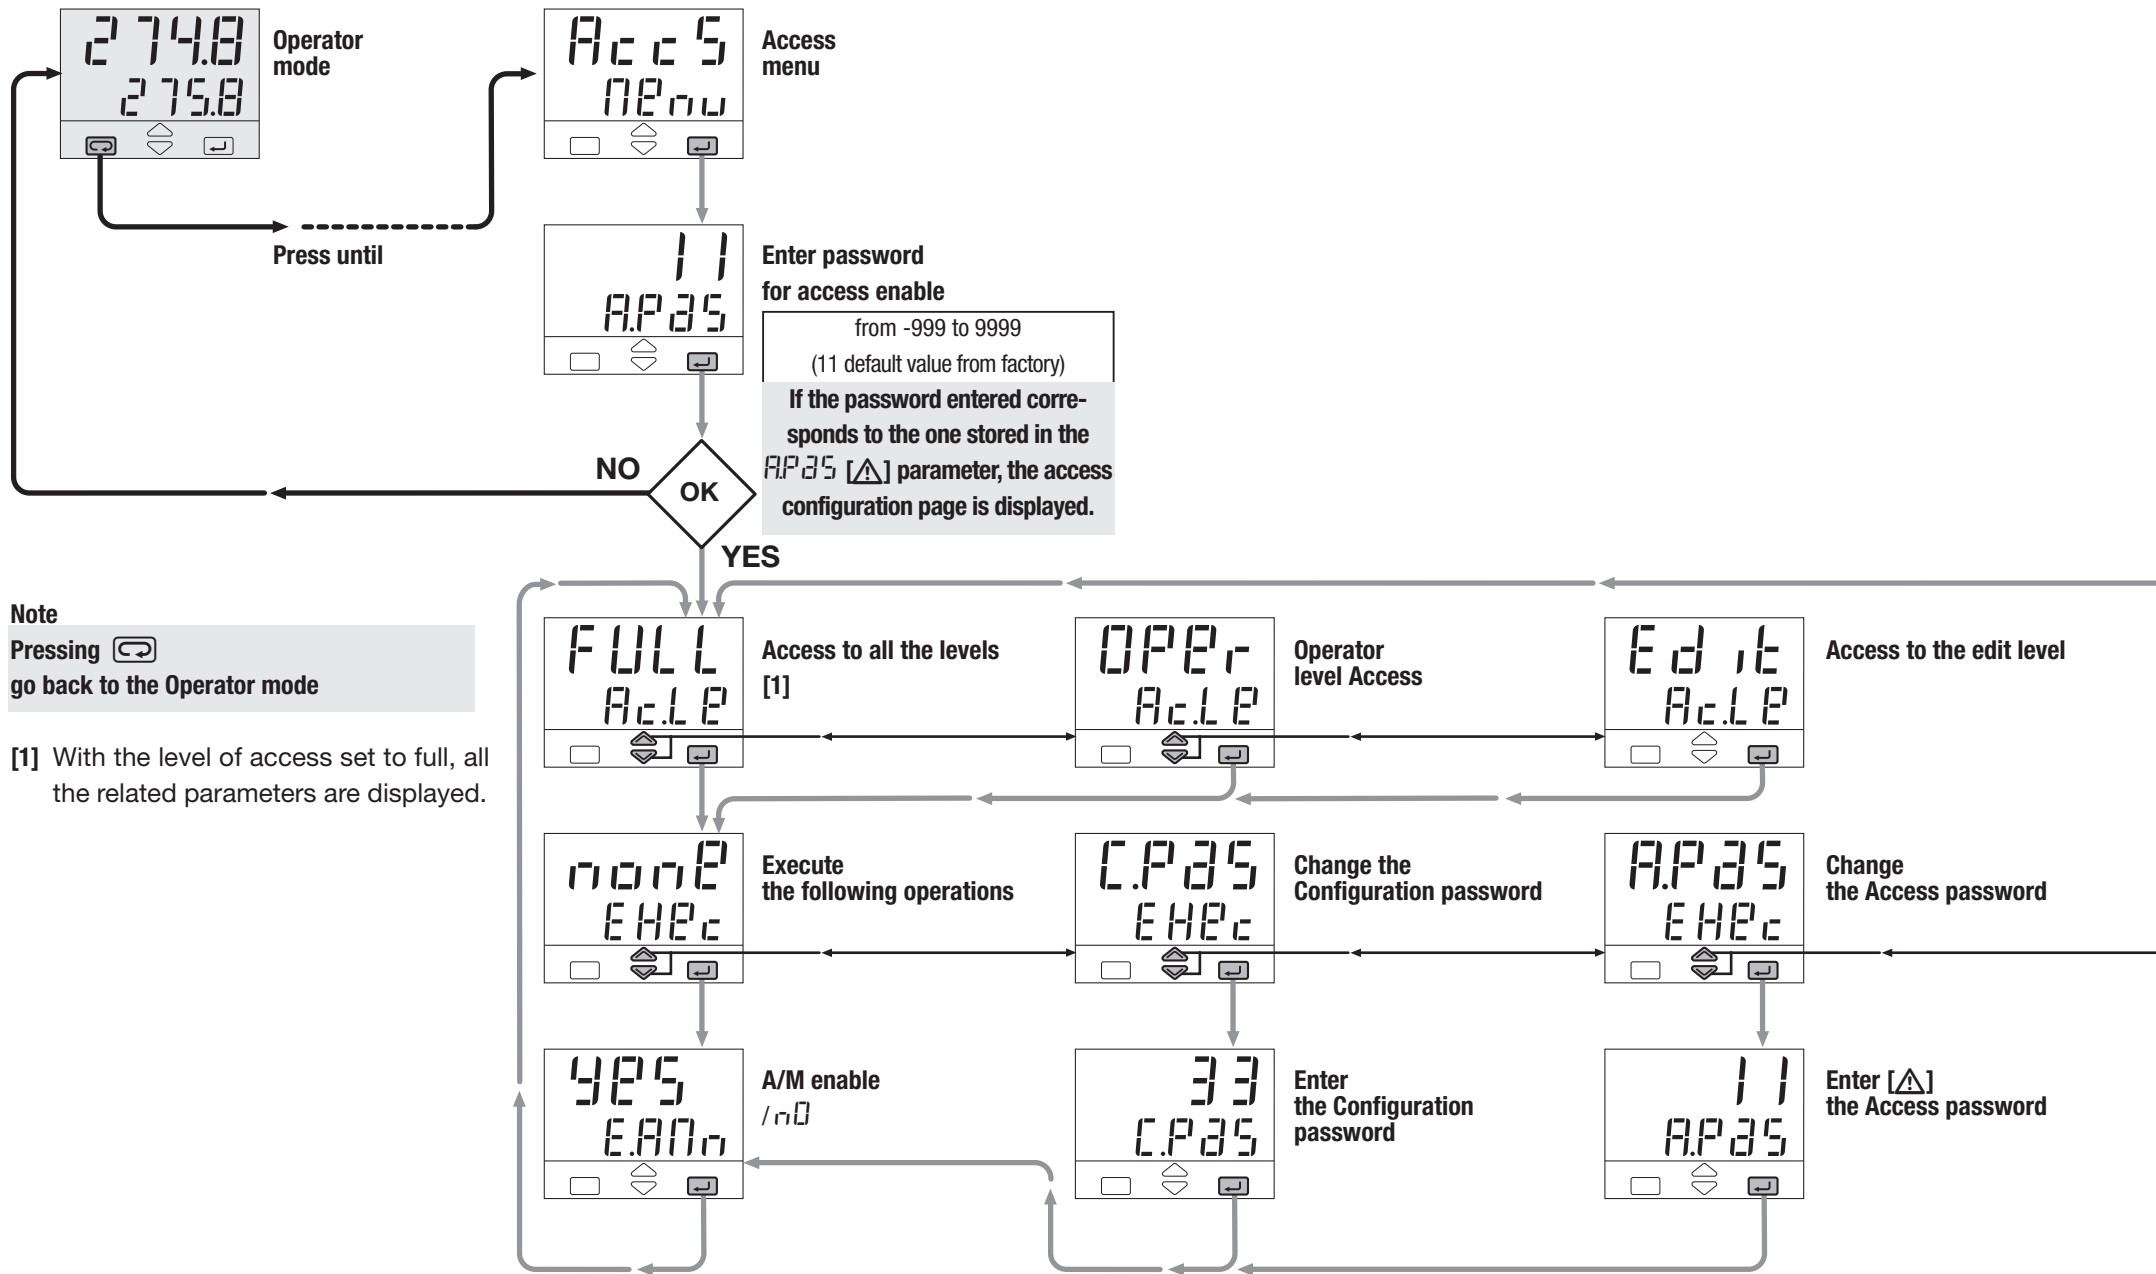





4.4 ACCESS LEVELS PASSWORD CALIBRATION

With the access level Edit, the user defines which groups and parameters are accessible to the operator

After selecting and confirming the access level Edit, enter in the parameters menu.

The code of the access level is displayed on the front panel.

Press the  and  keys to select the proper level.


Group of parameters	Code	Access level
	<i>rEad</i>	Visible
	<i>HiDE</i>	Not visible
Parameters	Code	Access level
	<i>AlEr</i>	Visible and changeable
	<i>FASt</i>	Included in "Fast view"
	<i>rEad</i>	Visible only
	<i>HiDE</i>	Not visible and not changeable

The parameters in the access level *FASt* are recalled on the front panel through the procedure of fast parameter access illustrated in par. 5.2 pag 29. The maximum number of fast parameters is 10.

At the end of the parameter list of the selected group, the controller quits from the Edit access level.


Therefore, the Edit level must be selected for each group of parameters

The access level of groups and parameters, is activated through

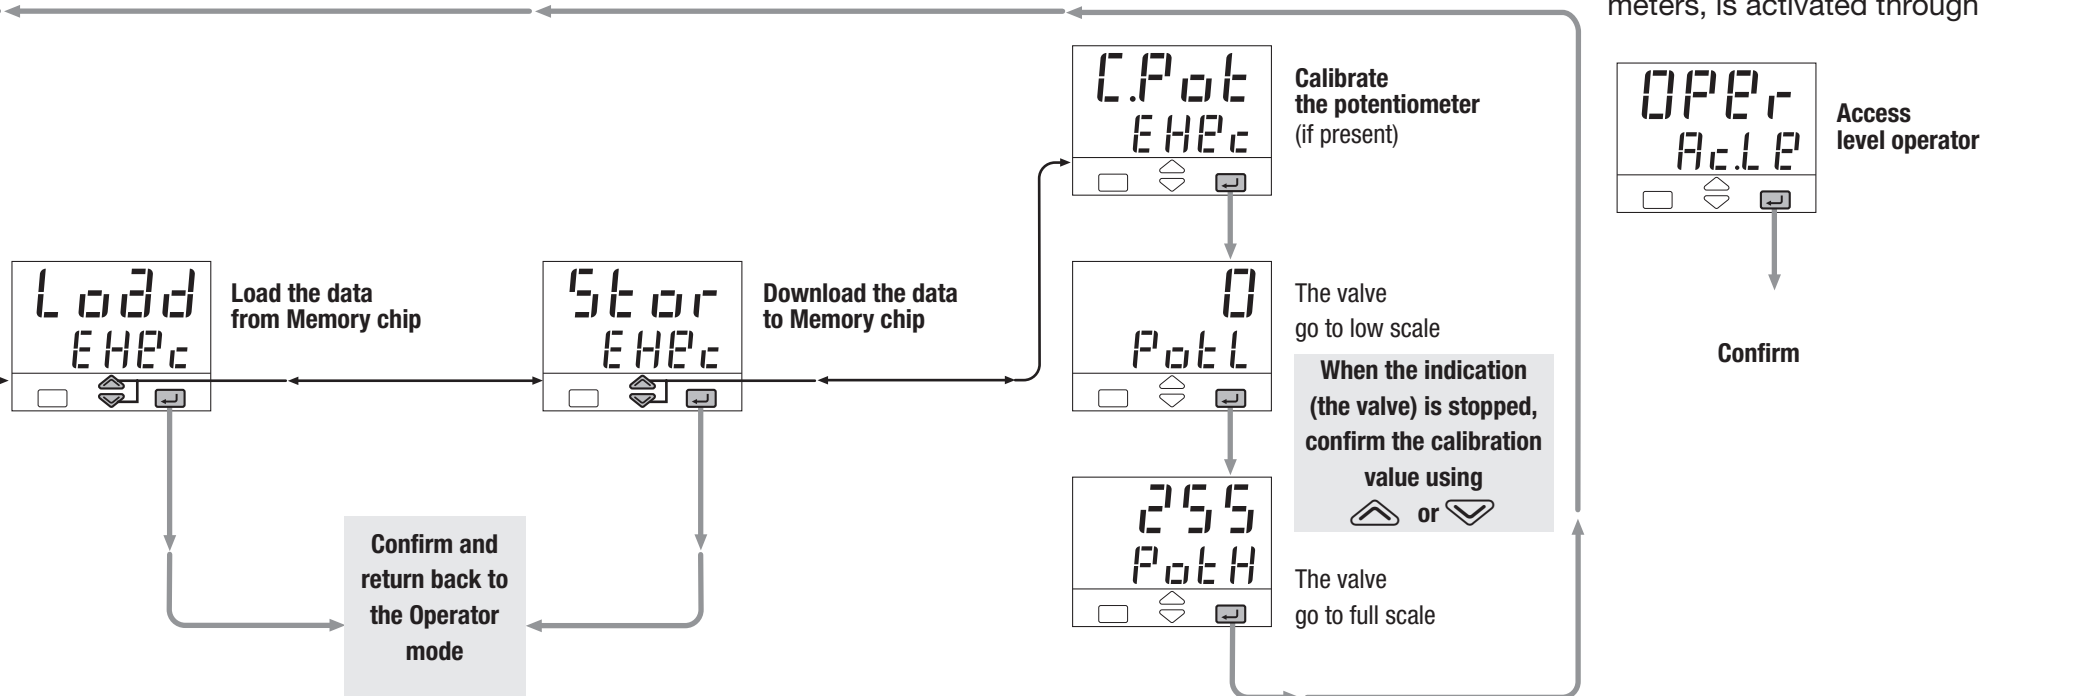

DISPLAYS


5.1 STANDARD DISPLAY

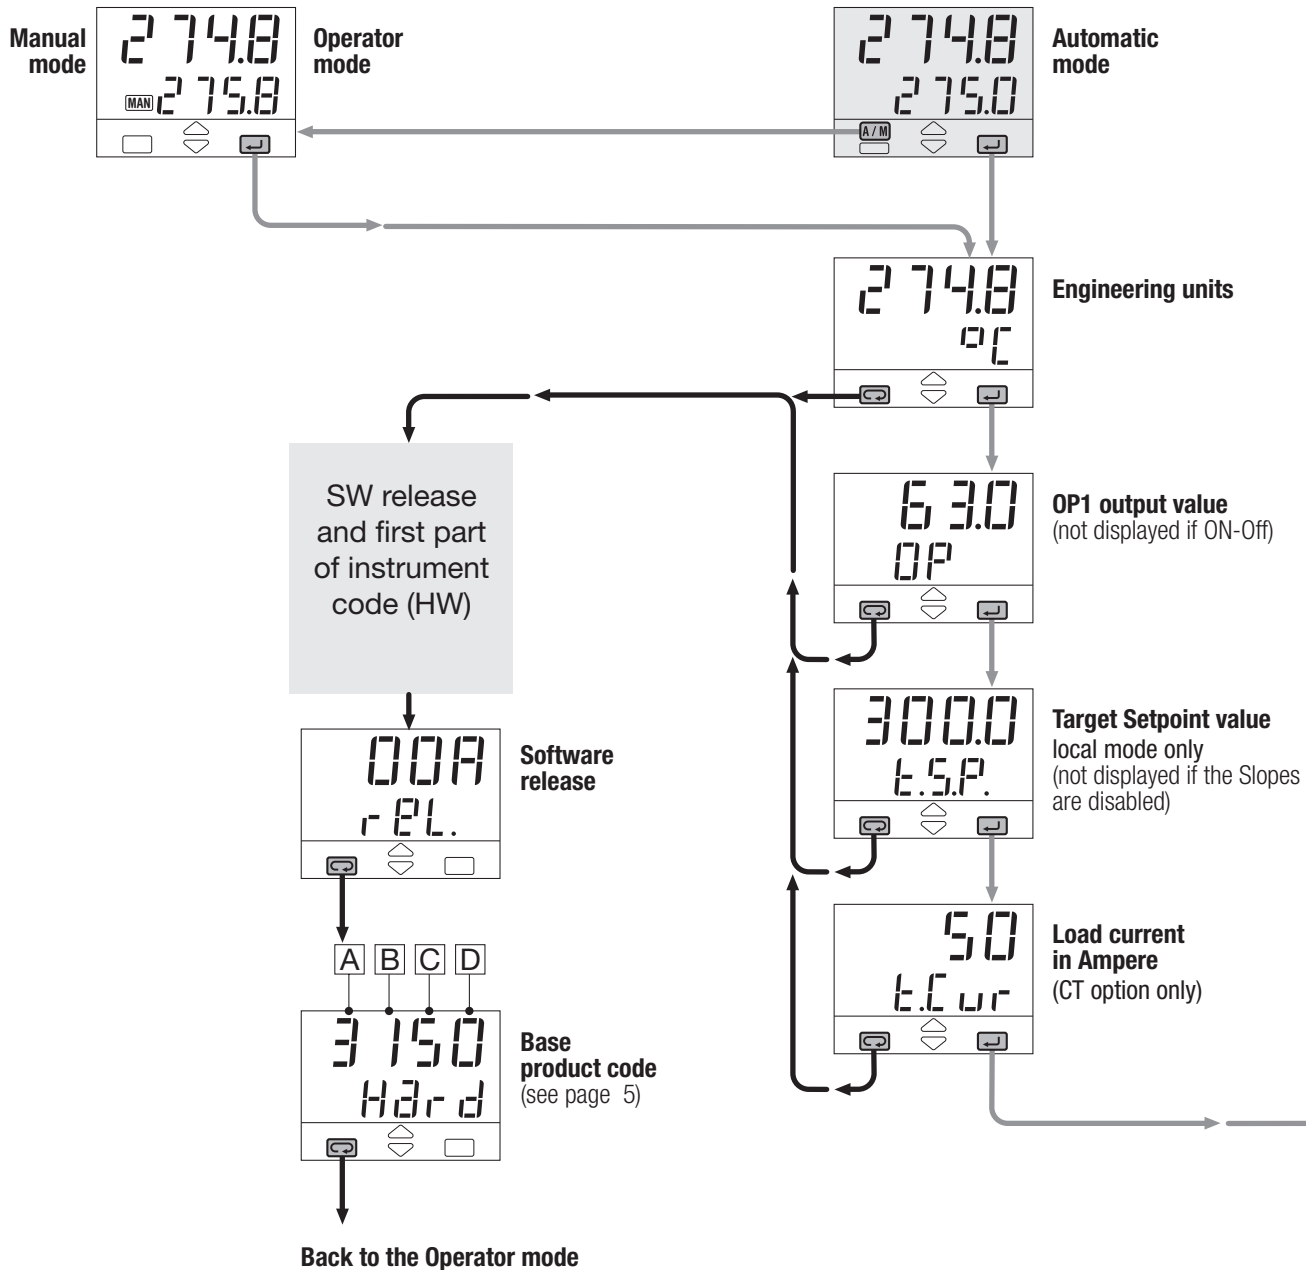

5.2 FAST VIEW (fast access to the parameters)

With this procedure, simple and fast, up to 10 parameters, selected through the fast view (see par 4.4 page 28) are displayed and can be modified by the operator without requiring the standard parameter setting procedure. Press in order to modify the parameters. The value is entered by pressing key.

Example of common parameters included in the fast view (fast access)

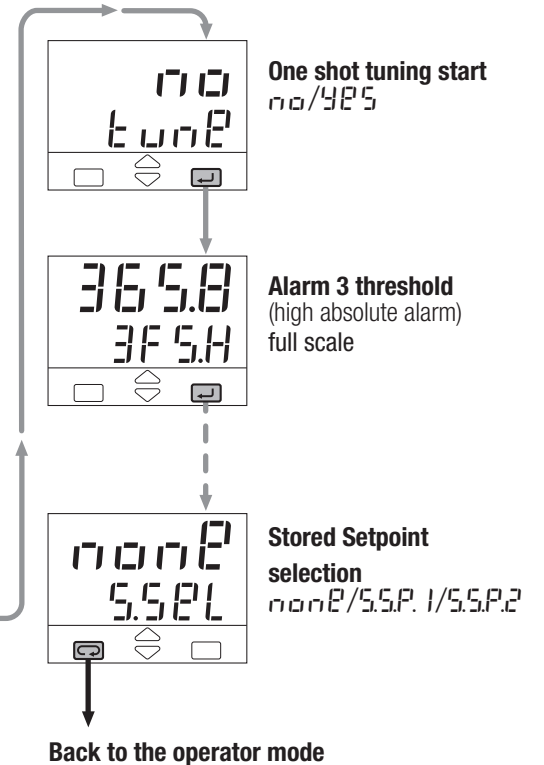

The commands can be entered
in 3 ways:




6.1 KEYBOARD

- Setpoint modification (page 31)
- local/remote selection (page 31)
- stored Setpoint display (page 31)
- manual mode (page 32)
- tuning start (page 32)
- programmer stop (page 38)

6.2 DIGITAL INPUTS

see page 33



6.3 SERIAL COMMUNICATIONS


see the manual on this topic




6.1 KEYBOARD COMMANDS

A. SETPOINT MODIFICATION

The Setpoint is directly modified with the keys. Once entered, the new value is checked and becomes operating after 2 seconds.. The end of this phase is flagged by flashing momentarily the display with SP.

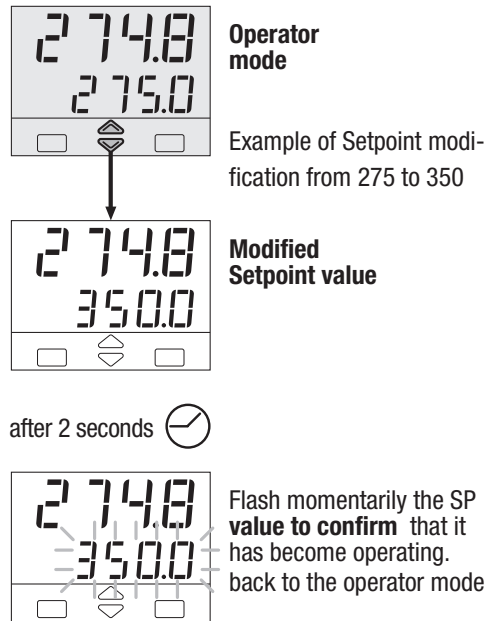


B. LOCAL/REMOTE

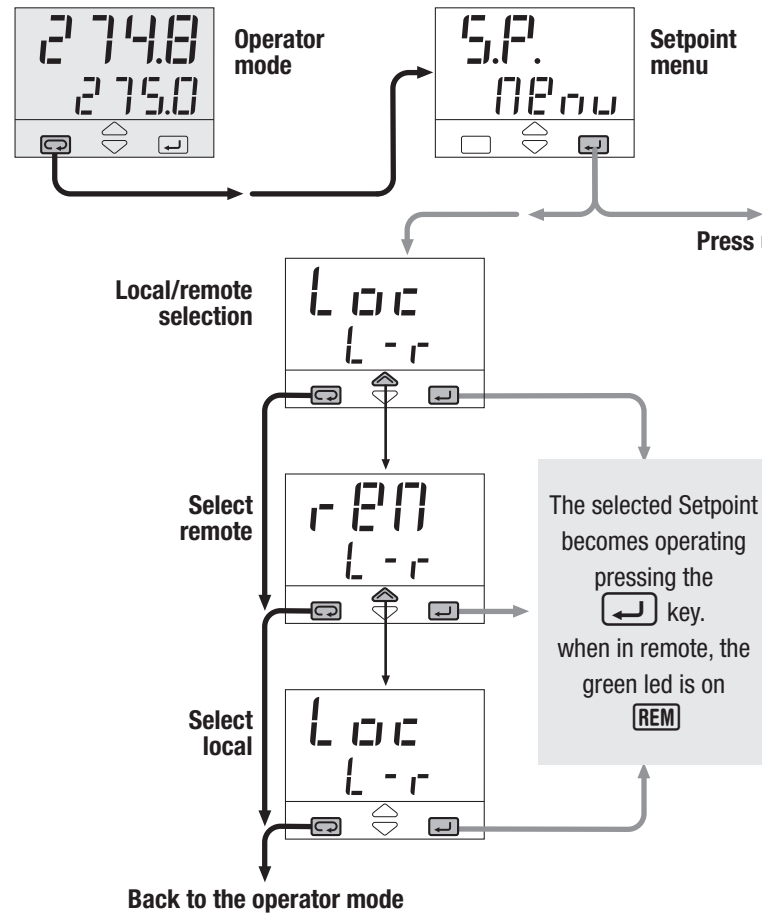


C. STORED SETPOINTS SELECTION

The Setpoint is directly modified with the keys. Once entered, the new value is checked and becomes operating after 2 seconds.. This phase is flagged by flashing momentarily the display with SP.


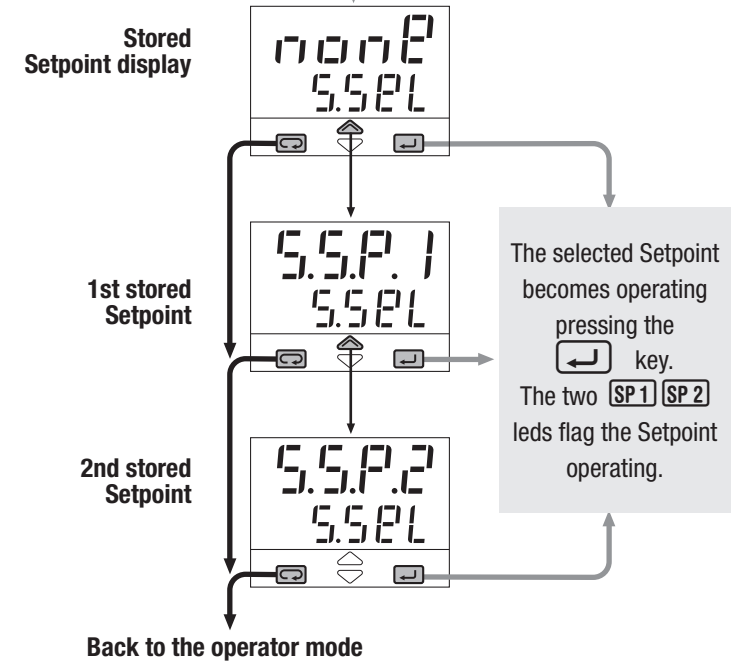


Note: When the Setpoint value is changed, the entered value is reached with a maximum rate set by the ramp up **SL.u** and ramp down, **SL.d** parameter. This applies to all the models and in all the operating modes. It is suggested to set **SL.u** and **SL.d** to **OFF** when the remote Setpoint is operating. The entered Setpoint is defined as target Setpoint. It is displayed in the function menu at the parameter **L - S.P.**

If the slope parameter is set to zero the Setpoint variation occurs instantaneously.

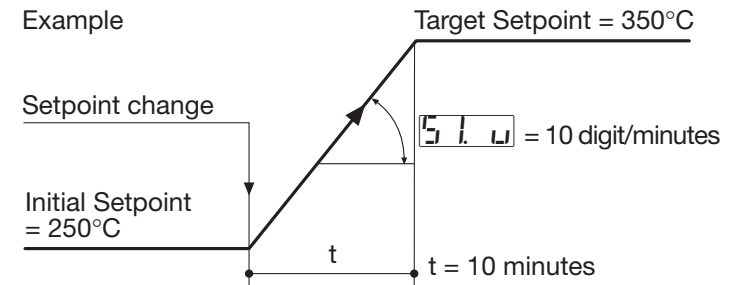


6.1.2 AUTO/MANUAL MODE

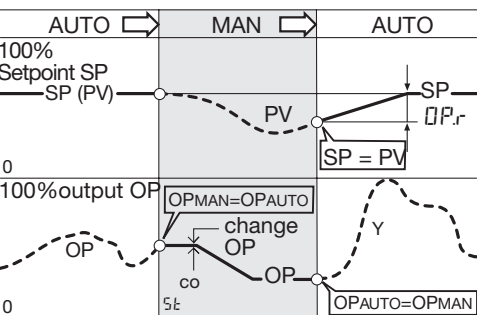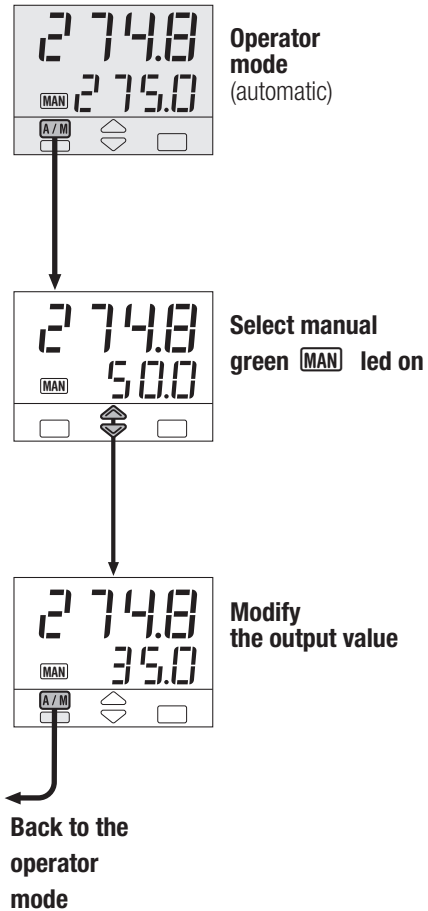

6.1.3 TUNING

This controller is provided with 2 different Tuning algorithm

- One shot tuning for calculating the optimal PID terms parameters.
- Continuous tuning (adaptive tuning) for a continuous calculation of the PID terms parameters in order to adapt the control to dynamically changing process or not linear ones.

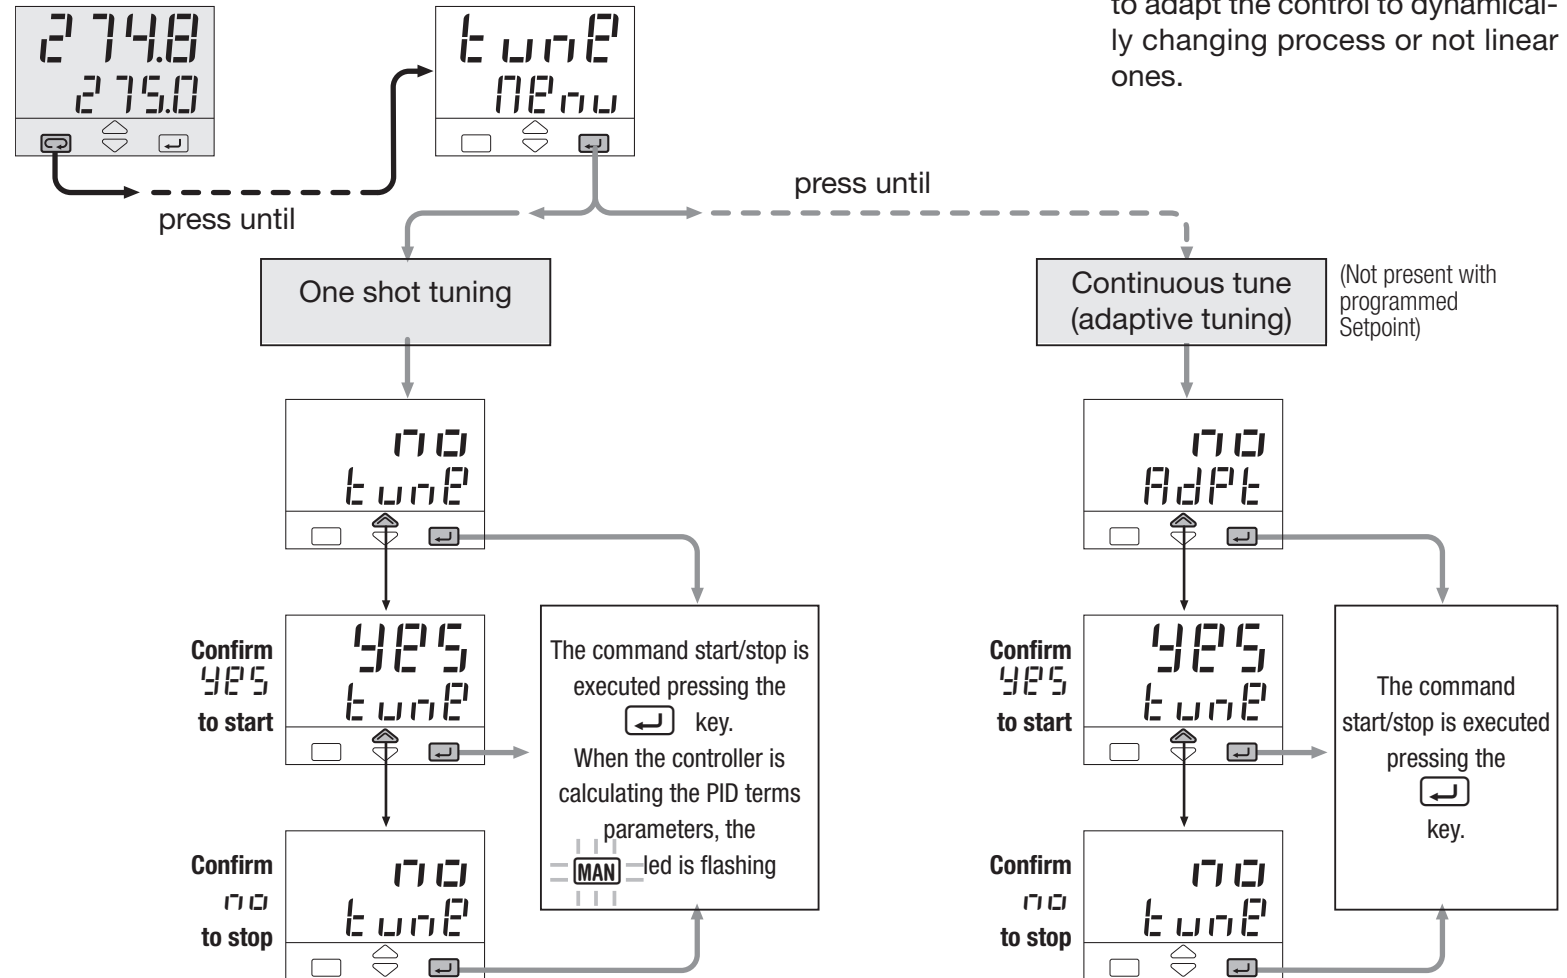

After the execution of the tuning, the calculated values are automatically presented in the PID menu.












When this function is in progress, the calculated values are visible in the Tuning menu but cannot be modified. (see page 21)

6.2 DIGITAL INPUT COMMANDS

A function is assigned, through the configuration procedure to each DI1 and DI2 digital input. (see the parameters setting at tab 8 at pag 17).

The configured function is activated when the digital input (free voltage contact or open collector output) is in the On state . It is deactivated by setting the input to the Off state.

The activation of the function through the digital input has the highest priority than through the keypad or through the serial communication.

Function		Parameter value	Performed operation		Note
			 Off	 On	
None			—	—	Not used
Set manual mode			Automatic	Manual	
Keypad lock			Unlock	Locked	With the keypad locked the commands from digital inputs and serial communication are still operating
PV measure hold			Normal operation	PV is hold	The value of PV is “frozen” at the time the digital input goes to the close state
Setpoint slopes inhibition			Rate limiting is active	Normal operation	When the input is in the on state, the Setpoint is changed in steps
Standard Setpoint	1st stored Setpoint		Local	1st SP	If more than one digital input is selecting a Setpoint, the last to be activated is the one operating.
	2nd stored Setpoint		Local	2nd SP	
	Remote Setpoint		Local	Remote	
Programmed Setpoint	Start/stop of a program			Hold/Run	The status (RUN/HOLD) changes every time the digital input switches from Off to On.

7 PROGRAMMED SETPOINT

INTRODUCTION

The controller supplied with the Setpoint programmer option (mod. M5000-3... 1) offers, in alternative to the adaptive tuning, the functionality to define, store, display and execute a program consisting in the Setpoint profile in time.

MAIN CHARACTERISTICS

- 1 program, 16 segments/program
- start, stop, hold etc, commands from the keyboard
- time base in seconds, minutes or hours
- continuous or up to 1...9999 time cycling of the program
- 1 OP3 digital output with the state profile defined by the program
- setting of the maximum allowed deviation from the Setpoint

7.1 PROGRAM STRUCTURE


The program consists of a sequence of segments.

For each segment, it is specified:

- the Setpoint to reach SP_{i-1}
 - the duration of the segment t_{i-1}
 - the state of the OP3 output
- } always present

The program consists of:

- 1 initial segment named I
- 1 end segment named F
- 1...14 normal segments

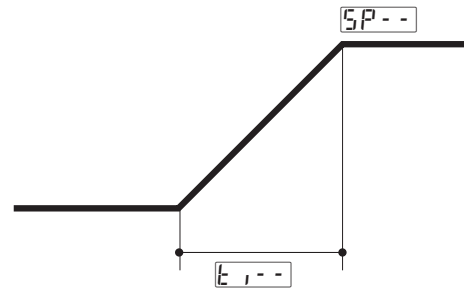

Initial segment

Its main purpose is to define the value the process variable has to maintain before starting the program.


End segment

Its main purpose is to define the value the process variable has to maintain at the end of the program and until further changes of Setpoint.


Normal segments

These segments build up the profile program. There are 3 types of segments:


Ramp

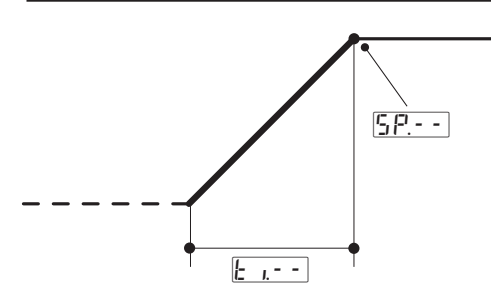

Dwell


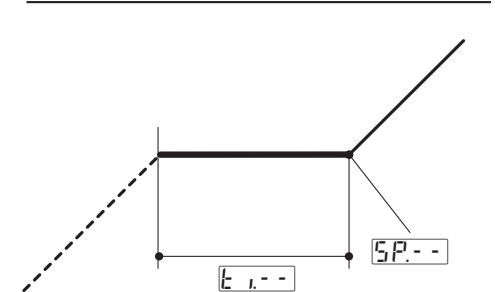


Step

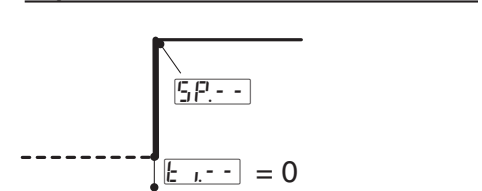

- SP_{i-1} = Target setpoint
- t_{i-1} = Duration
- = Previous segment
- = Current segment
- = Next segment

EXAMPLE OF SETPOINT PROFILE

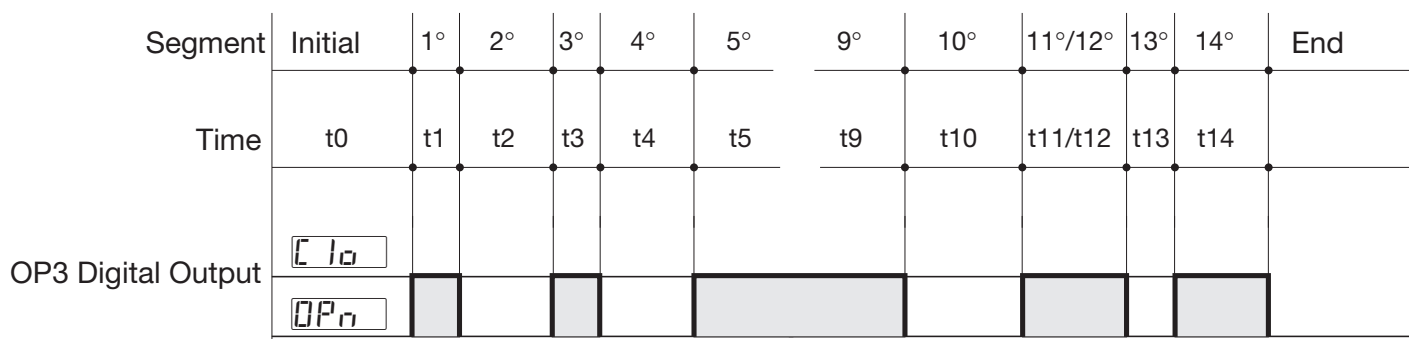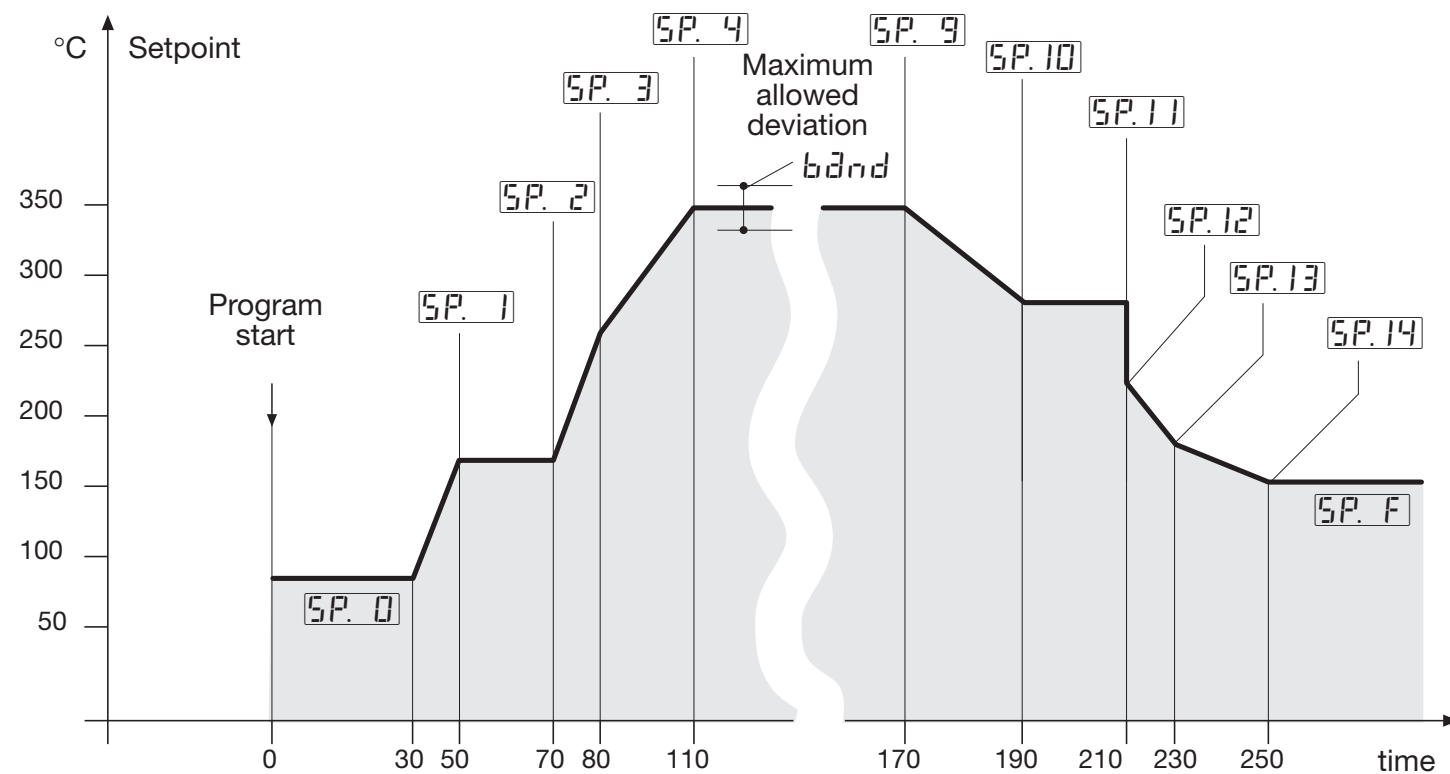

The OP3 digital output state, during the segments, is defined in the program

I₀ contact close (On)


O_{P₀} contact open (Off)

7.2 SETPOINT PROGRAMMER OPERATION


7.2.1 MAXIMUM ALLOWED DEVIATION (*band*)

If the PV controlled input value exceeds the band, centred around the SP, the segment time is extended of the same time the PV input stays out of the band. The band width is defined in a parameter of the program segment. The actual segment period is calculated as $t_{ramp} + T_i$

A. Ramp

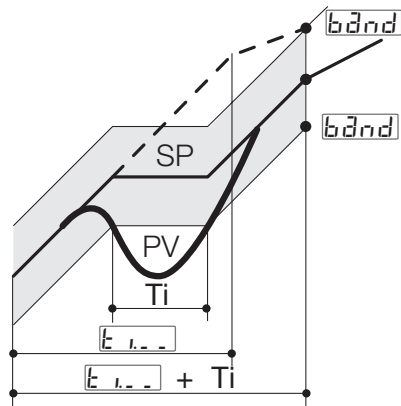

B. Dwell

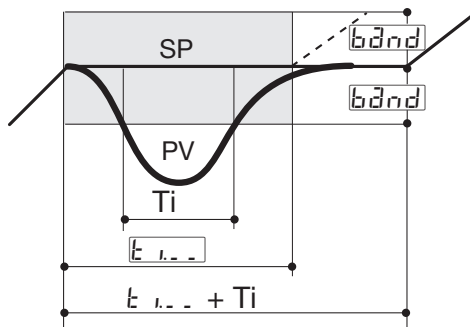

7.2.2 RE-START OF A PROGRAM AFTER A POWER FAILURE

The parameter *Fail* specifies the behaviour of the programmer at power up (see pag.37). Selected between the following 3 choices:


Cont Continue

res Reset

ramp Ramp

If *Cont* is selected, the execution of the program starts from the point reached at the power failure time.

All the parameters, like Setpoint and the remaining time are restored at the values they had at power off.

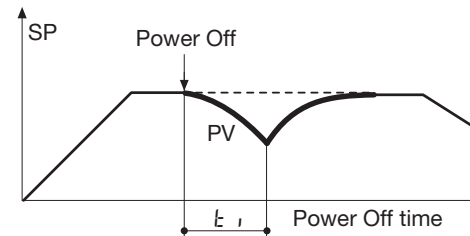


If *res* is selected, at power on the program ends and goes back to local mode.

If *ramp* is selected, the execution of the program starts from the point reached at the power failure time.


In this case, the programs continue with PV reaching SV with a ramp, whose slope corresponds to the one of the segment running at the power off.

The drawing below illustrates the situation.

Power off during a dwell

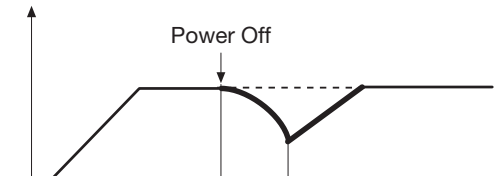

Power off during a ramp

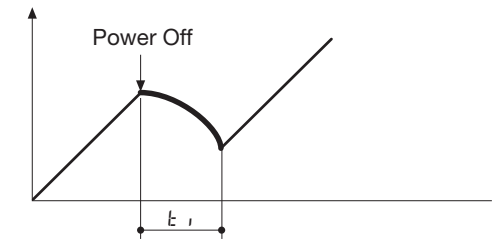

7.3 CREATION AND MODIFICATION OF A PROG.




Operator mode




Program menu
(if present)


PARAMETER MENU




Program status
rES = reset
HOLD = hold
run = start




Restart after a power off
Cont = continue
rES = reset
rANP = continue with the slope




Time units
PSEC = seconds
Min = minutes
Hr = hours




N° of segments
1...14 max




N° of program cycles
OFF / 1...9999




Allowed deviation
OFF / 0...span/20




Segment 0 time
0.1...999.9 Unit




Segment 0 Setpoint
whole range




Segment 0 Digital output [1]
CLD = closed
OPN = open
OFF = inhibited




Segment 1 time
0.1...999.9 Unit




Segment 1 Setpoint
Intera scala



Segment 1 Digital output [1]



End segment Setpoint
whole range



End segment digital output[1]
CLD = closed
OPN = open
OFF = inhibited

Back to the 1st parameter

Continue for all the 14 normal segments


[1] One digital output is provided which can be controlled by the program. This output is OP3. If this functionality is not required, it can be inhibited by setting OFF the parameter dO...

7.4 START/STOP OF A PROGRAM

The various commands, supported by the controller, are different for each of the following operating phases:

- A] when in Local Setpoint mode
- B] during the execution of a program
- C] when the program is in hold

Commands supported by the controllers

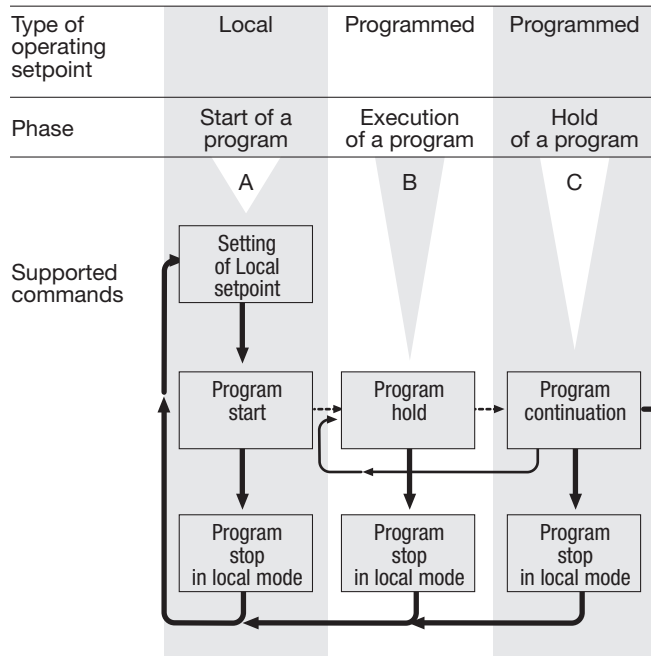

When the program is ended it comes back to normal mode


The different phase are displayed in a chained way, just for easing the understanding of the functionality.

Two different mode for starting and stopping a program are provided:

- direct mode with the key
- through the parameter menu

DIRECT MODE WITH

THROUGH THE PARAMETER MENU

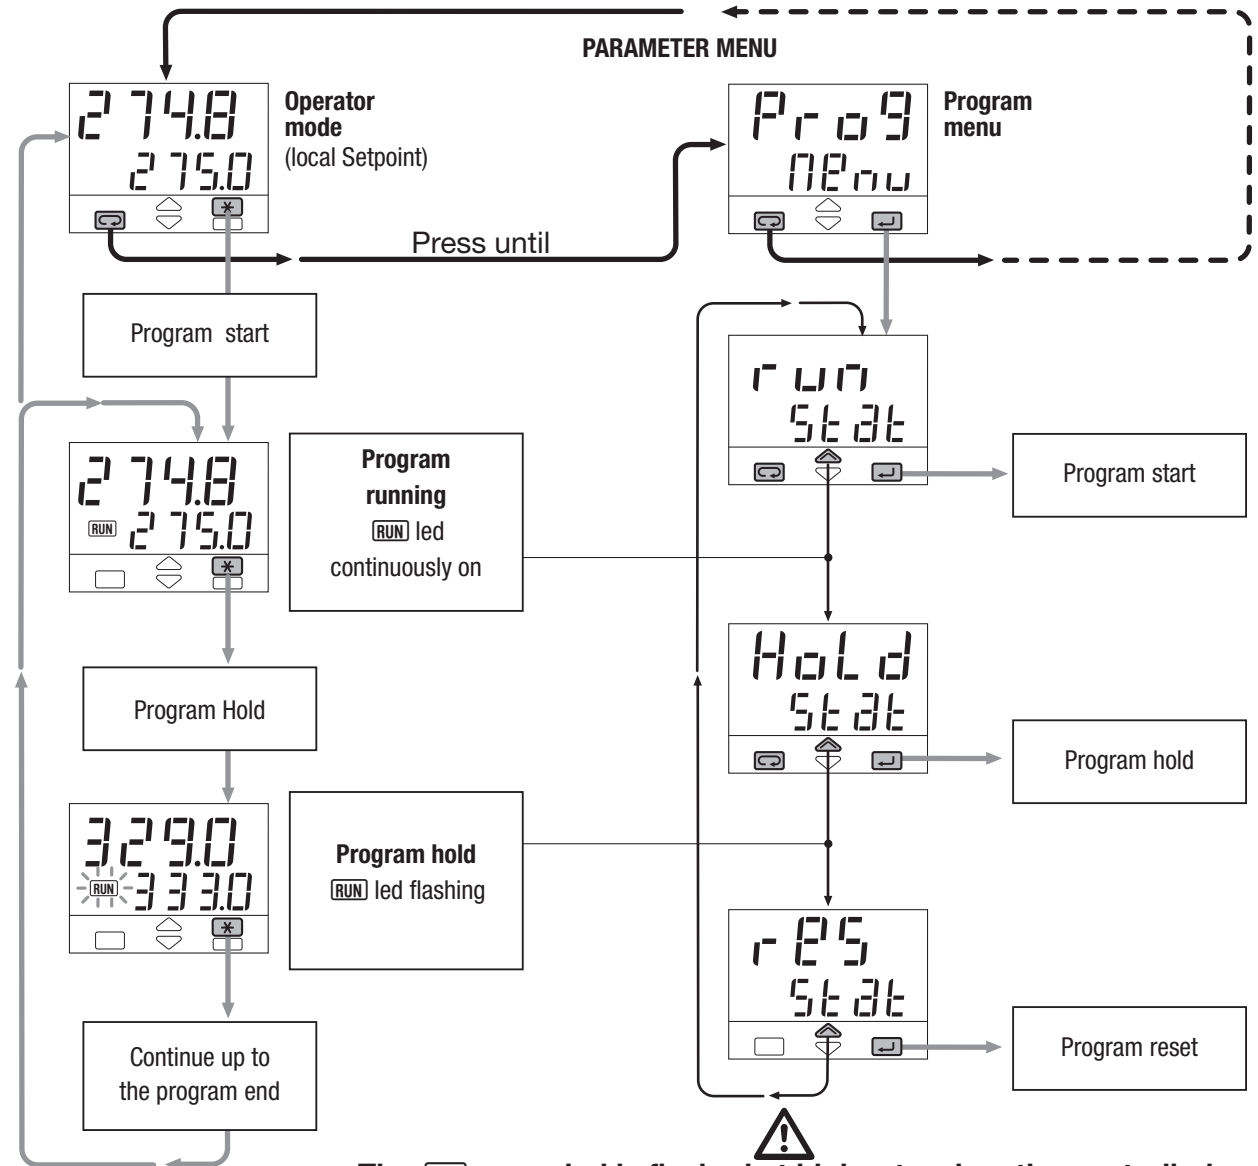

The green led is flashed at high rate when the controlled variable is out of the allowed deviation band
 The current time of a segment is hold up to the time the variable re-enter in the band.

8 TECHNICAL SPECIFICATIONS

Features at 25 °C env. temp.	Description			
Total configurability	The choices are: input type, operating mode, type of control, safety strategies, alarm strategies			
Operating modes	1 loop with single/double output			
	1 loop as the latter with the addition of the Setpoint programmer			
Control mode	Algorithm	PID with overshoot control or On-off		
		PID with velocity algorithm, for controlling motorised valves		
	Proportional band (P)	0.1...999.9%		
	Integral time (I)	1...9999 sec.	(user enabled/disabled)	PID control
	Derivative time (D)	0.1...999.9 sec.		
	Error band	0.1...10.0 digit		
	Manual reset	1...100% output	(user enabled/disabled)	Time proportioning control
	Cycle time	0.2...100.0 sec.		Discontinuous control
	Hysteresis	0.1...5.0%		ON-Off control
	Dead band	0.0...5.0%		Heat/Cool control
	Cool proportional band	0.1...999.9%		
	Cool Integral time	1...9999 sec.	(user enabled/disabled)	
	Cool Derivative time	0.1...999.9 sec.		
	Cool cycle time	0.2...100.0 sec.		
	Motor travel time	15...600 sec.		Motorised positioner
Motor minimum step	0.1...5.0%			
Feedback potentiometer	100Ω...10KΩ			
PV input (see table 1 page 18 for the signal ranges)	Common characteristics	A/D converter with resolution of 160.000 points Update measurement time: 50 ms Sampling time (max update time of the output) : 0.1...10.0 sec. configurable Input bias: - 60...+ 60 digit Input filter with enable/disable 0.1...999.9 sec.		
		Accuracy	0.25% ± 1 digits for temperature sensors 0.1% ± 1 digits (for mV and mA)	Between 100...240V~ the error is minimal

Features at 25 °C env. temp.	Description			
PV input	Resistance thermometer (for ΔT : R1+ R2 must be <320 Ω)	Pt100 Ω a 0°C (IEC 751) °C/°F selectable	2 or 3 wires or 2 Pt100 for ΔT	Max. wire res.: 20 Ω (3 wires) Input drift 0.1°C/10°C Env. temperature <0.1°C/10 Ω Wire Resistance
	Thermocouple	L,J,T,K,R,S (IEC 548) °C/°F selectable	Internal cold junction compensation	Max. wire res.: 150 Ω Input drift <2 μ V/°C Env. temperature <5 μ V/10 Ω Wire Resistance
	DC input (current)	0/4...20mA Rj = 30 Ω	Engineering units Configurable decimal point position with or without $\sqrt{\quad}$ Initial scale.: -999...9999 Full scale.: -999...9999 (minimum range of 100 digits)	Input drift <0.1% / 20°C Env. temperature <5 μ V/10 Ω Wire Resistance
	DC input (voltage)	0...50 mV Rj = 10M Ω 1-5/0-5/0-10V Rj = 10K Ω		
Auxiliary inputs (options)	Remote Setpoint Not isolated accuracy 0.1%	Current 0/4...20mA Rj = 30 Ω	Bias in engineering units and \pm range	
		Voltage 1-5/ 0-5/ 0-10V Rj = 300K Ω	Ratio from -9.99...+99.99 Local + Remote Setpoint	
	CT current transformer	max span 50 or 100 mA hardware selectable	Display from 10 to 200 A resolution of 1A with alarm threshold (Heater break alarm)	
	Potentiometer	100 Ω ...10K Ω supply 300mV	Position feedback measurement	
Digital inputs	2 logic	The closure of the external contact produces any of the following actions:	Auto/Man mode change, Local/Remote Setpoint mode change, Stored Setpoints activation, keypad lock, measure hold and slopes inhibit. Start, stop, hold of a program (only with Setpoint programmer)	
Control output (cont.)	Single or double channel, direct or reverse action			
	Minimum limit	0...100.0% (OP1 heat)		
	Maximum limit	0...100.0% (OP1 heat), -100.0...0% (OP2 cool)		

Features at 25 °C env. temp.	Description				
Control output	Maximum slope	0.01...99.99%/sec. up and down			
	Safety value	-100...100% . (user enabled/disabled)			
	Time proportioning	Relays	SPST N.O., 2A/250Vac resistive load		
		Triac	1A/250Vac resistive load		
		Logic	0...22V-, 20mA max (for Solid State Relay)		
	Analogue	Current	0/4...20mA max 750Ω/10V max	Galvanic insulation 500V~/1min. Resol.: 12 bit (0.025%) Accur. 0.1%. Short circuit protection	
		Voltage	0...1/5/10V 500Ω / 20mA max		
Valve Drive (open, stop, close)	2 x SPST Relay interconnected N.O., 2A/250Vac resistive load				
Alarms	Relay SPST N.O., 2A/250Vac resistive load Hysteresis 0.1...5.0% symmetrical				
	Actions	Active high	Action type	Deviation threshold	± range
		Active low		Band width	0...range
		Special functions		Absolute threshold	Whole scale
	Heater Break detection				
	Loop Break Alarm				
	Activation inhibit (blocking)				
Acknowledge (latching)					
Related to the program (optional) (OP3)					
OP4 analogue output (optional)	Galvanic insulated: 500 V~/1min. Resolution: 12 bit (0.025%) Accuracy: 0.1% . Short circuit protected	Current 0/4...20mA 750Ω/10V max	Retransmission of PV or SP		
	Voltage 1-5/0-5/0-10V 500Ω/20mA max				
Setpoint	Ramp up and down, with slope in digit/sec., digit/minute or digit/hour between 0.0...10.0% of the range High and low limits	Local plus 2 stored Setpoints			
		Only Remote			
		Local and Remote			
		Local with trim			
		Remote with trim			
	Time programmable (optional)				

































Features at 25 °C env. temp.	Description	
Programmable Setpoint (optional)	1 program, 16 segments (1 initial and 1 end) From 1 to 9999 cycles or continuous cycling (FFF) Time values in seconds, minutes and hours Start, stop, hold, etc. activated from the keyboard, digital input and serial communications.	
Tuning	One shot Tuning- step response method for calculating the PID terms parameters Adaptive Tuning self-learning, not intrusive, analysis of the process response to perturbations and continuously calculation of the PID parameters (not available with the Setpoint Programmer option)	
Auto/Manual station	Integrated in the controller, bumpless Operated from keyboard, digital input and serial communication.	
Serial com. (optional)	RS485 isolated, Modbus-Jbus, 1200, 2400, 4800, 9600, 19200 bit/sec., 2 wires	
Auxil. supply	18V- ± 20%, 30mA max for transmitters (2, 3, 4 wires)	
Operational safety	Measure input	Detection of out of range, short circuit or sensor break with automatic activation of the safety strategies and alerts on display
	Control output	Safety value: -100...+100%. (user enabled/disabled)
	Parameters	Parameters and configuration data are stored in a non volatile memory for an unlimited time. They are organised in functionally homogeneous groups, like: visible and changeable, visible and not changeable, not visible.
	Access protection	Password to access the configuration data and the parameter protection menu
General characteristics	Supply	100 - 240V~ (- 15% + 10%) 50/60Hz or 24V~ (- 25% + 12%) 50/60Hz and 24V- (- 15% + 25%) power consumption 3W max
	Electric safety	Compliance to EN61010, installation class 2 (2500V) pollution class 2
	Electromagnetic compatibility	Compliance to the CE standards for industrial system and equipment
	Approvals	UL, cUL
	Protection EN650529	IP20 termination unit, IP65 front panel
	Dimensions	1/16 DIN - 48 x 48, depth 150 mm, weight 230 gr. apx.

 **WARRANTY**

We warrant that the products will be free from defects in material and workmanship for 3 years from the date of delivery.

The warranty above shall not apply for any failure caused by the use of the product not in line with the instructions reported on this manual.

ICONS TABLE

Main universal input	Digital input	Digital input connected functions
 Thermocouple	 Isolated contact	 Auto/Manual
 RTD (Pt100)	 NPN open collector	 Run, Hold, Reset and program selection
 Delta Temp (2x RTD)	 TTL open collector	 PV hold
 mA and mV		 Setpoint slopes inhibition
 Custom	Setpoint	
 Frequency	 Local	Output
	 Stand-by	 SPST Relay
Auxiliary input	 Keypad lock	 Triac
 Current transformer	 Outputs lock	 SPDT Relay
 mA Remote setpoint	 Start-up function	 mA
 Volt Remote setpoint	 Timer function	 mA mV
 Feedback potentiometer	 Memorized	 Logic
	 Remote	
	 Setpoint programmer	